




SMITH
FLUID
CONTROLS®

JAY R. SMITH MFG. CO.®
MEMBER OF MORRIS GROUP INTERNATIONAL
POST OFFICE BOX 3237
MONTGOMERY, ALABAMA 36109-0237 (USA)
TEL: 334-277-8520 FAX: 888-377-7818 www.jrsmith.com

LOCATION

ELECTRONIC TRAP PRIMING DEVICE

WITH FLUSH MOUNT ENCLOSURE

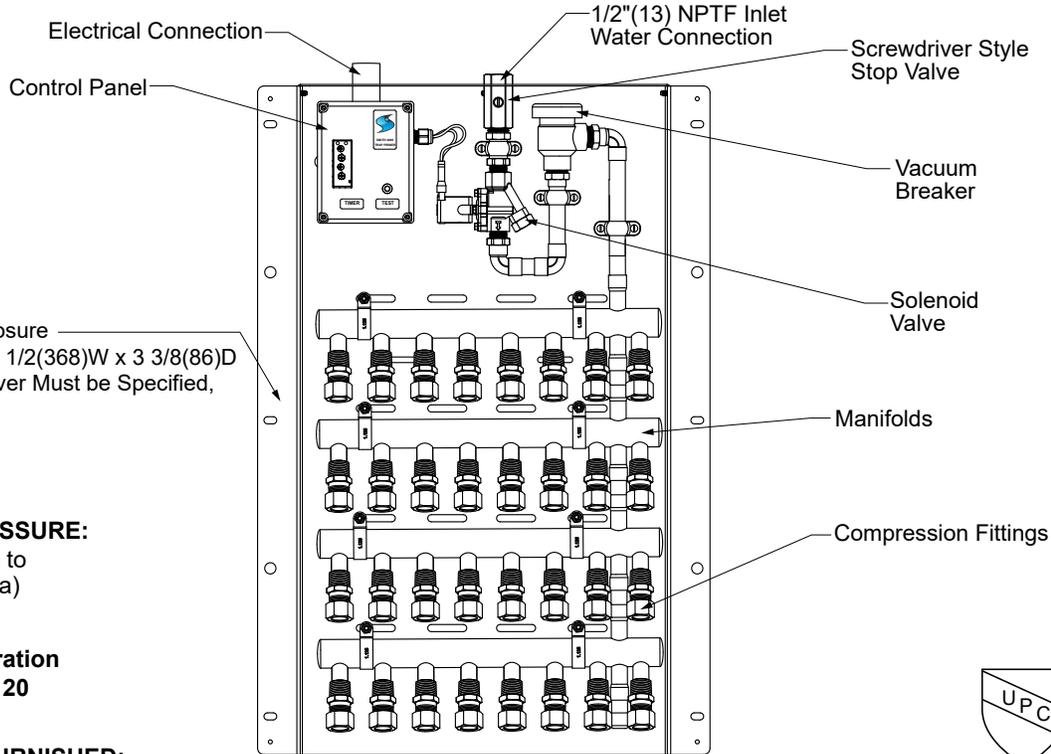

Flush Mount Enclosure
24 1/4(616)H x 14 1/2(368)W x 3 3/8(86)D
(Note: Type of Cover Must be Specified,
See Variations.)

WORKING PRESSURE:
20 PSI (138kPa) to
100 PSI (689 kPa)

Shown in Illustration
272FM-32-500-120

REGULARLY FURNISHED:

Galvannealed Steel Flush Mount Enclosure (Cover Must be Specified), Floor Drain Trap Priming Device consisting of a Solenoid Valve, Vacuum Breaker, a Timer (factory preset to discharge once per twenty-four-hour period) and a Manifold with multiple, Compression Discharge Ports (specify number of outlets) allowing the unit to serve multiple floor drain traps. This device is supplied with hardwired type electrical connections and has provisions to interface with a Building Management System (BMS) where applicable.

SPECIFY AC VOLTAGE: HARDWIRED

- 24V~60Hz / 0.50A -024
- 120V~60Hz / 0.10A -120
- 240V~60Hz / 0.05A -240

SPECIFY NUMBER OF OUTLETS:

- 26 28 30 32


SPECIFY OUTLET TYPES:

- 1/2"(13) OD Compression Fittings -500
- 5/8"(16) OD Compression Fittings -625

NOTES:

- All wiring must follow and be in accordance with National, State and Local Electrical Codes.
- The outlet of the trap primer valve shall be a minimum of 12"(305) above the finished floor before a 90° elbow can be installed. See Installation Instructions.
- Dimensions shown in parentheses are millimeters unless otherwise specified.
- Unit must be installed level and be accessible.

272FM-XX-XXX-XXX

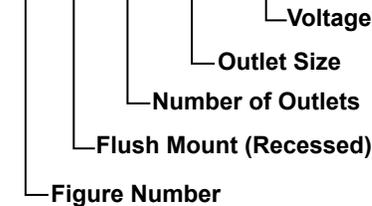

FILE 3253



UL 1951
CSA C22.2 NO 68
CSA C22.2 NO 14
FILE E10084

VARIATIONS:

- Galvannealed Steel Cover -GC
- Stainless Steel Cover -SSC
- Hinged Access Door with Screwdriver Latch -SL
- Hinged Access Door with Cylinder Lock -CL
- Vandal Proof Cover Screws -U (Only available with -GC and -SSC)
- Stainless Steel Enclosure -SS
- Interface with Facilities Energy Management System -EMS



STD. 1044

DRAWING NUMBER
S272FM SERIES

SIZE
A

SCALE:
NONE

DATE:
6-3-19

APPROVED BY:
JM

CHECKED BY:
JM

DRAWN BY:
TBW

272FM SERIES

FIGURE NUMBER

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
							272FM SERIES



WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE