Whitehall Manufacturing®
Manufacturer of Healthcare and Rehabilitation Products since 1946

Use

FOOT AND ANKLE WHIRLPOOLS

P SERIES

10 GALLON STATIONARY WHIRLPOOL

WHP-10-S



WHP-10-S
Fixture May Show Available Options

Whitehall® WHP-10-S Stationary Whirlpool

Tank Capacity is 10 gallons.

Whirlpool Tank is 22"L x 13"W x 12"D and is seamless welded construction, fabricated from heavy gauge, type 304 stainless steel, polished to a satin finish. Tank rim is reinforced with a concealed stainless steel rod. Tank bottom is seamless, coved (rounded) design for effective cleaning. Tank is also provided with an extended stainless steel skirt flush to the floor line to conceal internal drain piping. A 2" Combination Drain Overflow and a Filler Spout are provided.

Turbine Raising and Lowering Device permits adjustment of desired height and direction of water agitation towards the area of the body during Whirlpool use. It is spring balanced and provided with a locking device.

Turbine Assembly is equipped with Underwriters Laboratory listed 1/2 HP jet pump motor protected with an ABS plastic shell, automatic thermal overload protector, and lifetime-sealed bearings. All parts contacting the water are stainless steel, chrome plated brass or bronze.

Thermometer is provided with a dual scale, adjustable calibration, and a stem inserts into a retainer to prevent rattle during whirlpool agitation.

Guide Specifications

Provide Whitehall Stationary Whirlpool (specify model number and options) with a 10-gallon capacity, 22"L x 13"W x 12"D. Whirlpool shall be fabricated from heavy gauge, type 304 stainless steel. Construction shall be seamless welded and exposed surfaces shall be polished to satin finish. Tank shall have a reinforced rim and shall be fitted with a stainless steel skirt flush to the floor line. Bottom of tank shall be a seamless, rounded coved design. Provide a 2" combination Drain Overflow, and a filler spout. Provide a turbine assembly with raising and lowering device which functions as an agitator and permits adjustment of desired height, direction of water agitation, and can be locked into place. Turbine assembly shall be UL listed 1/2 HP jet pump motor with automatic thermal overload protector and lifetime-sealed bearings. Provide a thermometer with a stem retainer to prevent rattle when whirlpool is in operation.

P SERIES
FOOT AND ANKLE WHIRLPOOLS

MODEL NUMBER AND OPTIONS SELECTION

NOTE: *This is an interactive PDF. For maximum readability: Turn Preferences > Forms > Highlight Color "Off"*

SERIES

☑ **WHP** Foot and Ankle Whirlpool

CAPACITY

☑ **10** Gallons

TYPE

☑ **-S** Stationary Whirlpool

TURBINE ELECTRICAL REQUIREMENTS (MUST SPECIFY)

❑ 115VAC / 60Hz (6.2 AMPS)

❑ 230VAC / 50Hz (3.5 AMPS) Country of Use: _____

FOR MIXING VALVE: Refer to supplemental MXT15-OTG and DU-1 sheet for details.

SUFFIX OPTIONS


(Refer to Supplemental Product Option Submittals for Details)

❑ **EG** Enviro-Glaze® Color Powder Coating – Specify Color: _____

❑ **GFI** Power Cord with Ground Fault Interrupter


❑ **LOGO** Applied Logos: Team, Company, Facility

❑ **SDO** Separate Drain and Overflow Assembly

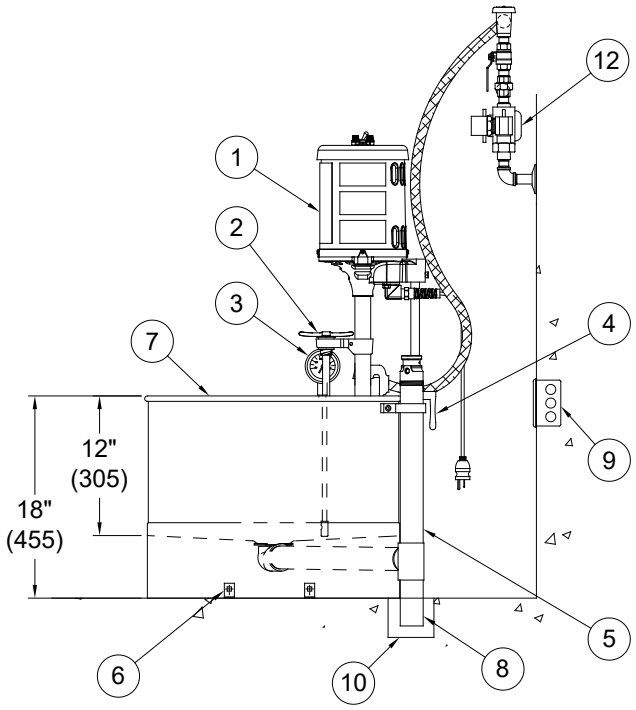

NOTES:

1. 1/2 HP Jet Pump Motor
2. Variable Pressure Control
3. Thermometer
4. Turbine Raising & Lowering Device
5. Combination Drain & Overflow Assembly
6. "L" Brackets – (4) Four Each
7. Stainless Steel Tank
8. 2" O.D. x 5" Tailpiece
9. 3 Pole GFI Receptacle by Others
10. Floor Drain by Others
11. Filler Spout
12. Mixing Valve, Shown for Reference Only

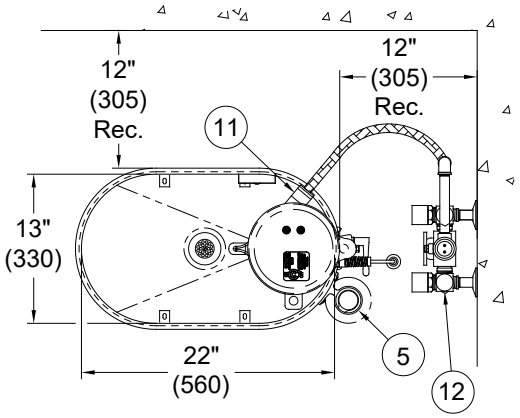

IMPORTANT: Dimensions shown for reference only. Refer to product installation instructions for complete details prior to rough-in.

APPROVAL FOR MANUFACTURING

Company _____ Date _____

Contact _____ Title _____

Approval for Manufacturing/Signature _____

All dimensions are nominal and subject to manufacturer's change without notice. Whitehall assumes no responsibility for use of void or superseded data. Please visit www.whitehallmfg.com for most current specifications. Warranty Info. © Copyright 2026

⚠ **WARNING:** Cancer and Reproductive Harm — www.P65Warnings.ca.gov