

FLOOR DRAINS

WITH 8 1/2"(215) ROUND ADJUSTABLE TOP AND "SAFE-SET®" SEDIMENT BUCKET

Load Rating: Light Duty having a Safe Live (Static) Load less than 2,000 lbs. (900 kg) per ASME A112.6.3 Floor Drain Standard. For the specific Safe Live Load rating of any grate, contact the Smith representative or factory direct.

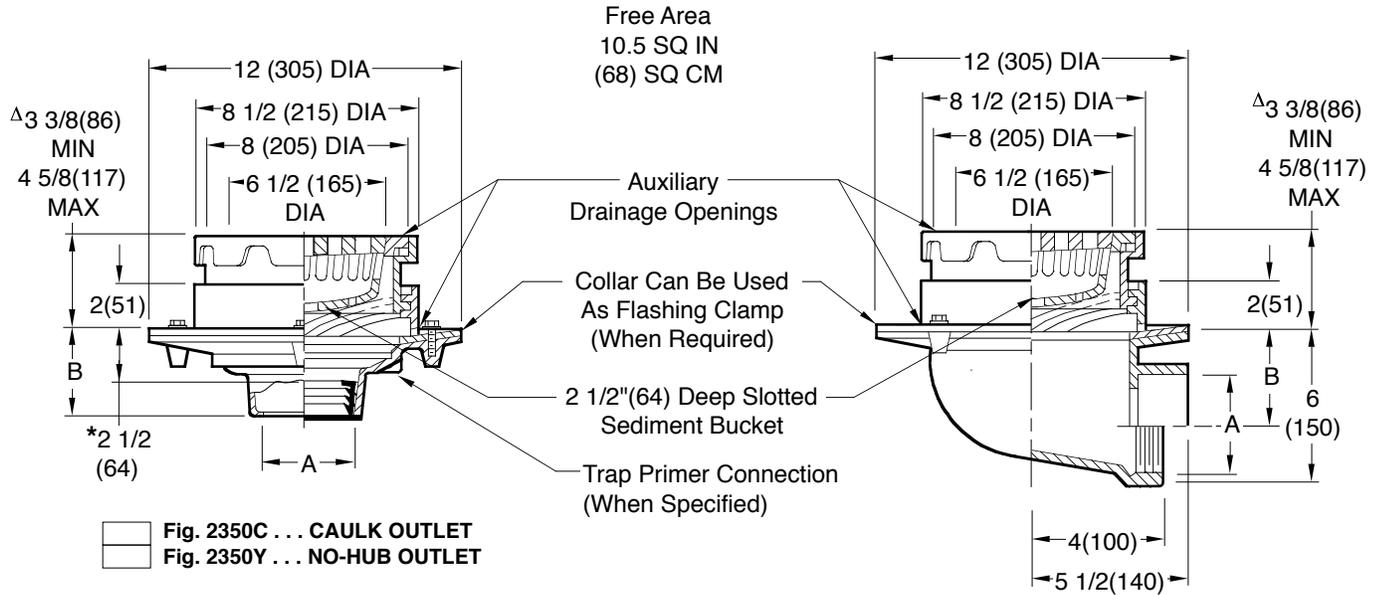


Fig. 2350C . . . CAULK OUTLET
 Fig. 2350Y . . . NO-HUB OUTLET

Fig. 2355C . . . CAULK OUTLET
 Fig. 2355T . . . THREADED OUTLET

A SIZE	02 (50)	03 (75)	04 (100)	06 (150)
B	3 3/4 (95) for Caulk, NO-HUB, and Speedi-Set®,		3 3/4 (95) NO-HUB Only	
	2 (51) for Threaded			

* This Dimension to Internal Stop of Speedi-Set® Gasket
 Δ Add 1/4"(6) when bronze top is specified.

A SIZE	02(50)	03(75)	04(100)
B	4 1/4(110)	3 3/4(95)	3 1/4(83)

REGULARLY FURNISHED:

Duco Cast Iron Body and Flashing Collar with Adjustable Top and Slotted ADA Grate with Sediment Bucket.

▲ Not available in Safe-Set design. Full grate is provided with a suspended bucket.

VARIATIONS:

- Dome Grate -D
- Extension (Specify Height) -E
- Flat Bottom Strainer -BB
- L Speedi-Set® Service Weight (Fig. 2350 only)
- LXH Speedi-Set® Extra Heavy (Fig. 2350 only)
- NO-HUB Adaptor (Specify Fig. 2646Y) (Fig. 2355 only)
- Square Top -S
- ** Trap Primer Connection -P050 1/2"(13) & -P075 3/4"(19)
- Vandal Proof Top -U
- T Threaded Outlet
- Quad Close Trap Seal (Specify Fig. 2692) (Fig. 2350 Only)

OPTIONAL MATERIALS:

- Ductile Iron Bucket and Grate -MGB
- Galvanized Cast Iron -G
- Nickel Bronze Top -NB
- Polished Bronze Top -PB

** Not available on Fig. 2350T threaded outlet drain.

NOTE: Dimensions shown in parentheses are in millimeters.

DRAWING NUMBER: S2350
 SIZE: A
 SCALE: NONE
 DATE: 5-17-85
 APPROVED BY: TD
 CHECKED BY: TD
 DRAWN BY: PJ
 FIGURE NUMBER: 2350, 2355
 DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE
 WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

P	2-23-23	Added "®" to Speedi-Set	KK	CL	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 2350, 2355
N	1-23-23	Added ADA	KK	JT			
M	5-19-2020	Added Load Rating	MW	JM			
L	6-18-19	Removed Function	MW	JM			
REV.	DATE	DESCRIPTION	BY	CKD. BY			