

ADJUSTABLE FIXTURE SUPPORTS FOR SIPHON JET WATER CLOSETS

HUB & SPIGOT VERTICAL FITTINGS EXTRA HEAVY DUTY - 750 LBS.

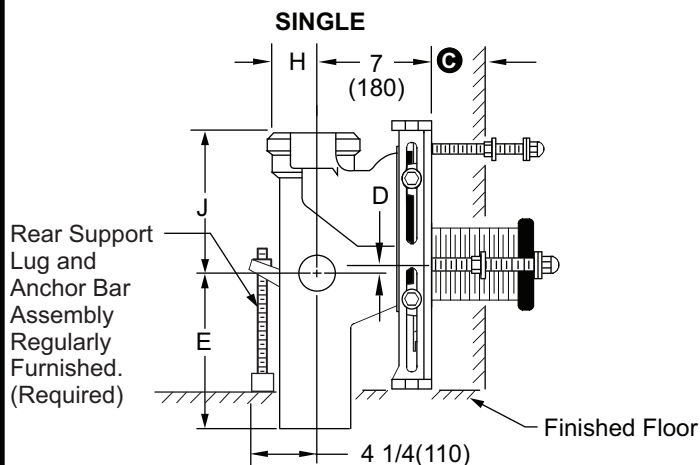


Fig. 0230-M58-M54-XX
Side View


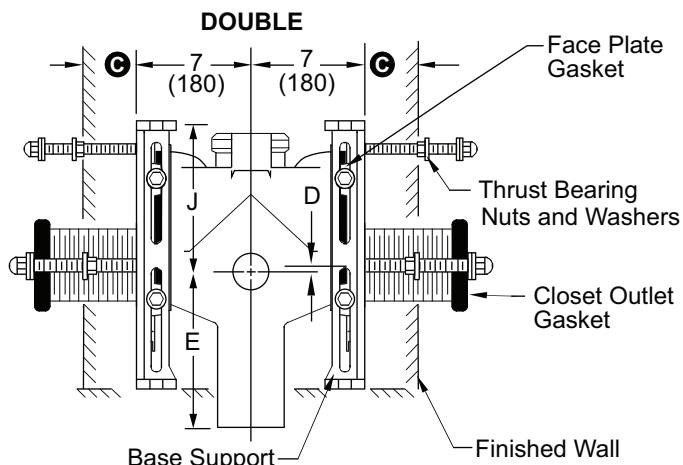


Fig. 0230D-M58-M54-XX
Side View

A SIZE	D		E	**F	H	J
	MIN	MAX				
4(100)	1 1/2(38)	4 1/4(110)	10(255)	5 1/4(135)	3(75)	9(230)
5(125)	1 1/2(38)	4 1/4(110)	11 1/2(290)	6 1/4(160)	3 1/2(89)	11 1/2(290)
6(150)	1 1/2(38)	4 1/4(110)	11 1/2(290)	6 1/4(160)	4(100)	11 1/2(290)

NOTE: Base support must be securely anchored to floor with 1/2" (13) anchors able to withstand a pull-out force of 500 lbs (227 kg). The rear anchor bar must be securely anchored to floor with 1/2" (13) anchors able to withstand a pull-out force of 1000 lbs (454 kg). Pull-out forces are calculated values, no safety factor has been applied.

NOTE: Dimensions shown in parentheses are in millimeters.

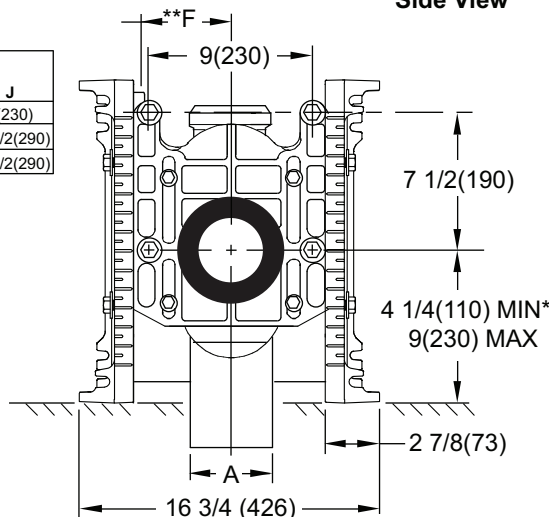

Front View

NOTE: When used with concealed flush valve locate face plate behind supply pipe.

NOTE: Shallower minimum rough-in dimension available to accommodate lower rough bowls. Specify dimension required.

NOTE: 1 1/2(38) or 2(51) NPT inlet available. Add suffix -N


***NOTE:** 9"(230) core drilled hole is required for rough-in 4 1/4(110) thru 6 1/2(165)

****NOTE:** "F" dimension is from centerline of vent to centerline of stack.

Fig. 0230-M58-M54-XX . . . CAULK
Fig. 0230D-M58-M54-XX . . . CAULK DOUBLE

Jay R. Smith 0230-M58-M54-XX complies with and/or exceeds all requirements of ASME A112.6.1M up to 750 lbs.

NOTE: When nipple lengths between 3 1/4"(83) and 9 3/4"(247) are specified, the 10"(255) nipple will be supplied. The threaded end of nipple must be cut to specified length by others. Absolute minimum dimension is 1 1/2" (38).

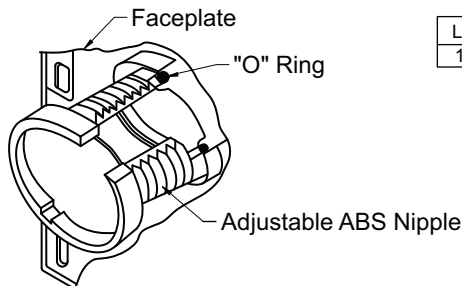

LENGTH	MIN.	C	MAX.
10(255)	8 3/4"(222)		9 3/4"(247)

*ABS (Regularly Furnished).

0230-M58-M54-XX

FIGURE NUMBER

B A	6-16-26 12-28-23	Revised NOTE Revised Dimension	TB HS	CL CL	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
REV.	DATE	DESCRIPTION	BY	CKD. BY			0230-M58-M54-XX