

NON-FREEZE ROOF HYDRANT



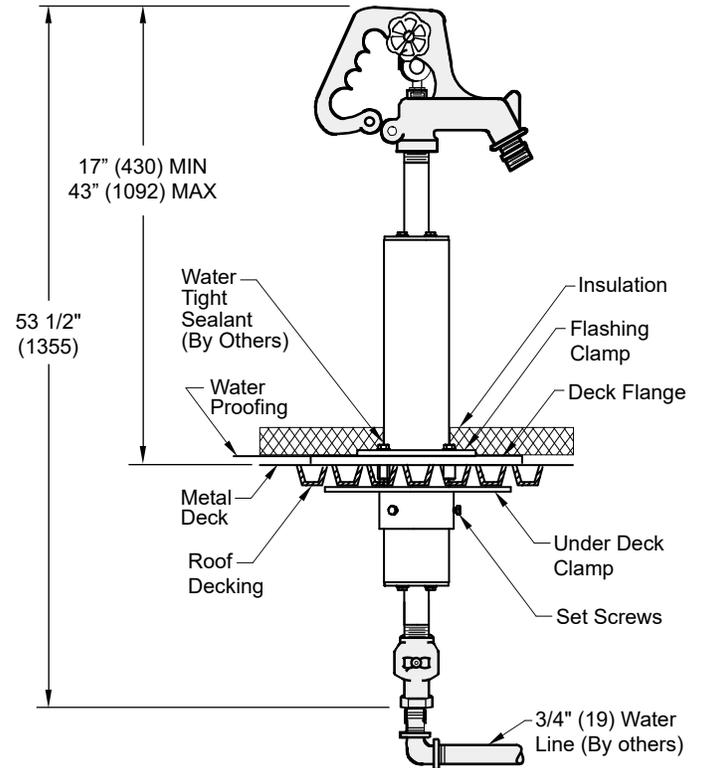


FIG. 5906

- NOTE:**
1. Drain Hole must be piped and discharged to an acceptable discharge point. Failure to do so will result in potential water damage which Smith is not responsible.
 2. Hose must be removed to allow proper draining of the casing. Smith is not responsible for any casings that burst or related incidents if the hose is not removed.
 3. Dimensions shown in parentheses are in millimeters.
 4. The AB100, AB1953, California Lead Law, and NSF/ANSI Standard 61- Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
 5. **FOR IRRIGATION PURPOSES ONLY.**
 6. Temperature Range: 33.0°F to 140.0°F (0.6°C to 60.0°C).

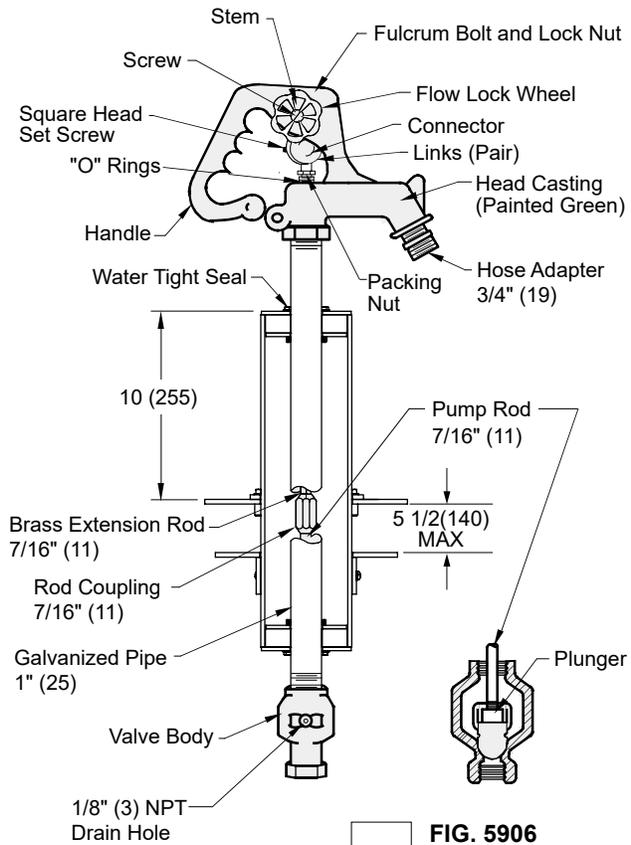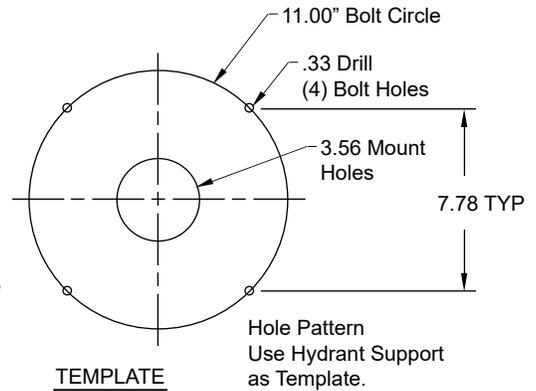

REGULARLY FURNISHED:
 Non-Freeze Roof Hydrant with Galvanized Casing and Adjustable Flow Wheel Lock Handle with Deck Flange and Under Deck Clamp.

VARIATIONS:
 Vacuum Breaker -H (Note 2)

P
 DRAWING NUMBER S5906
 SIZE A
 SCALE: NONE
 DATE: 3/4/09
 APPROVED BY: AM
 CHECKED BY: AM
 DRAWN BY: RN
5906
 FIGURE NUMBER

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA
 DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

P	2-4-25	Revised Notes	HS	BW	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 5906
N	8-4-23	Removed Function	HS	CL			
M	3-22-23	Added Notes 4 & 5/Removed ASL/TL	KK	JT			
L	1-18-23	Updated Tuesdail Note	KK	CL			
REV.	DATE	DESCRIPTION	BY	CKD. BY			