

MILD CLIMATE ANTI-SIPHON SILLCOCK

DUAL CHECK VALVE - BACKFLOW PROTECTED

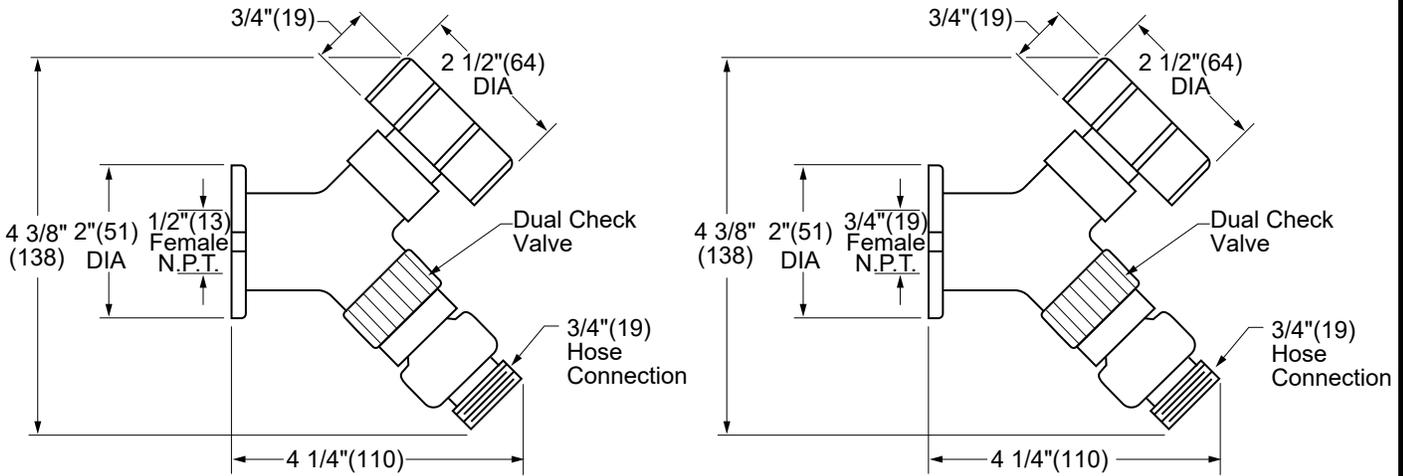


Fig. 5672 (-BFP).....1/2"(13) Inlet

Fig. 5673 (-BFP).....3/4"(19) Inlet

NOTES:

1. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
2. The Dual Check Valve may discharge water to prevent backflow. Do Not install where spillage may cause water damage.
3. Dimensions shown in parentheses are in millimeters.
4. **FOR IRRIGATION PURPOSES ONLY.**
5. Temperature Range: 33.0°F to 140.0°F (0.6°C to 60.0°C).

REGULARLY FURNISHED:

Hose Valve has a Rough Finish Brass Body
 Removable Wheel Handle, "T" Handle Key,
 NPT Female Threaded Inlet Size Indicated
 by Figure Number Selected and ASSE 1052
 Dual Check Valve with 3/4"(19) Hose Connection.

Installer is responsible for providing a 100% watertight positive seal at the hydrant to wall interface. Seal all the flange with an appropriate sealant recommended by a sealant manufacturer. **NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.**

NOTE: Dimensions shown in Parentheses are in millimeters.

DRAWING NUMBER: s5672, 5673 (-BFP)
 SIZE: A
 SCALE: NONE
 DATE: 7-11-11
 APPROVED BY: CL
 CHECKED BY: CL
 DRAWN BY: TBW
 FIGURE NUMBER: 5672 (-BFP) 5673 (-BFP)

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 5672 (-BFP) 5673 (-BFP)
F	2-3-25	Revised Notes	HS	BW			
E	10-3-24	Revised Drawing	HS	CL			
D	8-4-23	Removed Function	HS	CL			
C	4-5-18	Added Note	TBW	BW			