




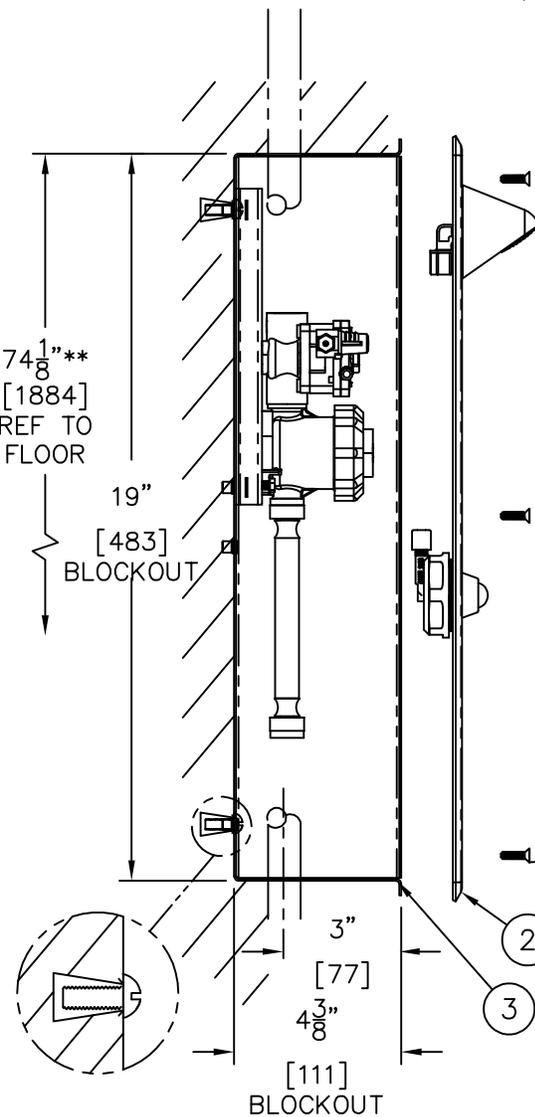

NOTE:
 ** DIMENSION SHOWN FOR
 INSTALLING MOUNTING FRAME
 HEIGHT IS INTENDED FOR 72"
 SHOWER HEAD DISCHARGE.

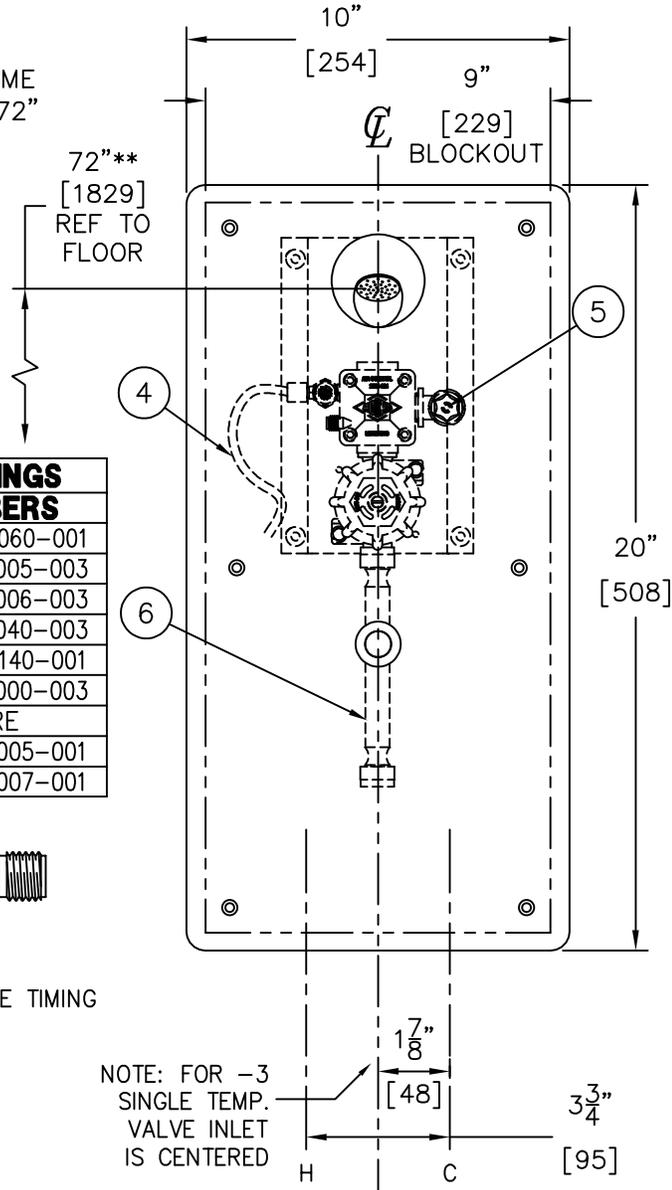

REFERENCE DRAWINGS	
ASSEMBLIES	NUMBERS
-PBH PUSHBUTTON	9957-060-001
-4 VALVE BODY H&C	9955-005-003
-3 VALVE BODY S/T	9955-006-003
STOP	9956-040-003
SHOWER HEAD	9970-140-001
-M METERING SERVOMOTOR	9955-000-003
PANEL HARDWARE	
SECURITY SCREWS	9951-005-001
MOUNTING NUTS	9951-007-001

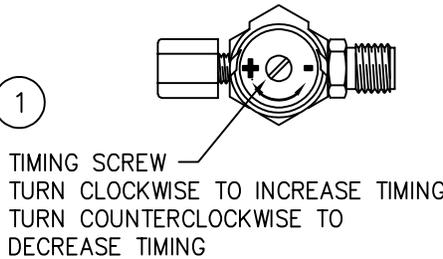

INSTALLATION INSTRUCTIONS

- A- REMOVE (6) MOUNTING SCREWS (1) HOLDING SHOWER PANEL (2) TO FRAME (3). CAREFULLY REMOVE SHOWER PANEL (2); DISCONNECT AIR LINE (4) AND WATER LINE (5) FROM AIR CONTROL VALVE.
- B- BLOCK OUT EXISTING WALL FOR MOUNTING FRAME (3) 19" x 9" x 4-5/16" DEEP.
- C- INSTALL MOUNTING FRAME WITH SUITABLE FASTENERS; DRILL THRU HOUSING TO WALL AND INSTALL WALL ANCHORS. FASTENERS BY OTHERS. ROUGH-IN SUPPLIES; MOUNTING FRAME MAY BE POSITIONED FOR SUPPLIES THROUGH TOP OR FROM BOTTOM.
- H- AFTER THOROUGHLY FLUSHING THE SUPPLY LINES, MAKE-UP SUPPLY CONNECTIONS (1/2" NPS FEMALE).

- (NOTE: SUPPLY INLET CONNECTION WILL ACCOMODATE 1/2" NPT MALE ADAPTER). THREAD FLEX CONNECTOR HOSE (6) TO VALVE INLET AND TO SUPPLY STUBOUTS.
- D- RECONNECT AIR LINE (4) AND WATER LINE (5). TIGHTEN FERRULE NUTS HANDTIGHT.
- E- REATTACH (6) MOUNTING SCREWS (1).

NOTE:
 MAXIMUM RECOMMENDED WORKING PRESSURE IS 100 PSI; TEMPERATURE IS 130F; OUTLET TEMPERATURE IS RECOMMENDED AT A MAXIMUM OF 105F.

**INSTALLATION REQUIRES THE USE OF AN APPROPRIATE CERTIFIED THERMOSTATIC MIXING VALVE PROVIDED BY OTHERS, PER APPLICABLE CODE.

WARNING:
 PRIOR TO MAKING INSTALLATION, SUPPLY LINES MUST BE FLUSHED OF ALL FOREIGN MATERIAL SUCH AS PIPE DOPE, CHIPS, ETC. VALVE MUST BE DRAINED PRIOR TO BEING SUBJECTED TO FREEZING TEMPERATURES. MAXIMUM RECOMMENDED OUTLET WATER TEMPERATURE IS 105F.

ACORN ENGINEERING COMPANY
 P.O. BOX 3527 Industry, CA 91744
 15125 Proctor Ave Industry, CA 91746
 (626) 336-4561 FAX (626) 961-2200

TITLE SECURE-CARE FRONT ACCESS WALL SHWR. - LR1741FA-3/ LR1741FA-4		
MANUFACTURE DATE JUNE 2023	DATE ISSUED 6/20/2023	DRAWING NUMBER 9925-152-001
TO PRESENT	DATE REVISED	