
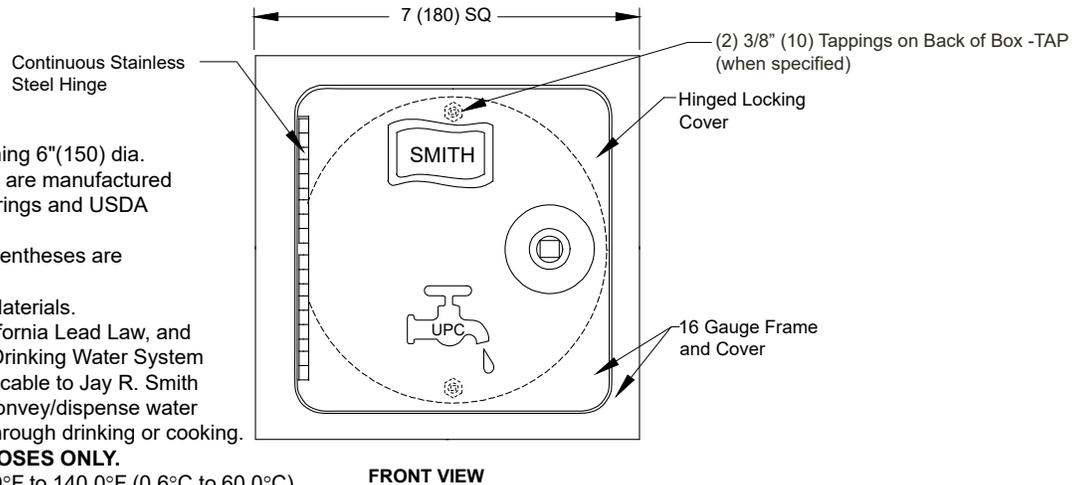


# NARROW WALL WARM CLIMATE HYDRANT

## HYDRANT BOX FOR 6"(150) DIAMETER CORED HOLE IN CONCRETE WALL

Installer is responsible for providing a 100% watertight positive seal at the hydrant to box interface and hydrant to wall interface. Seal all interior joints, seams, gasket seams/closures including around the hydrant box flange with an appropriate sealant recommended by a sealant manufacturer. NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.

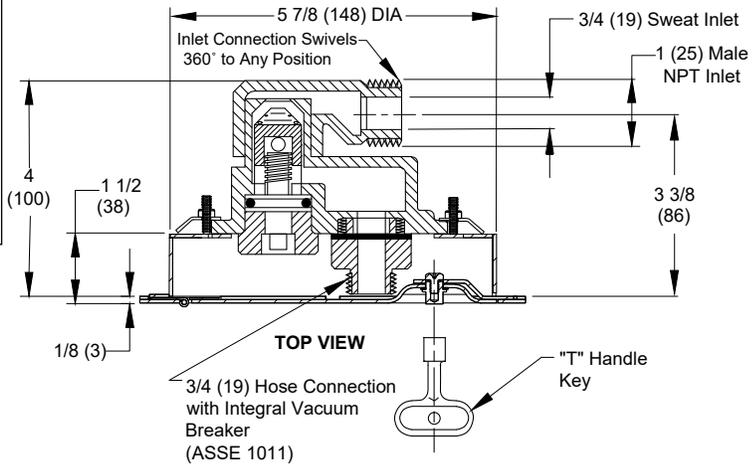

**NOTES:**

1. Recommended wall opening 6"(150) dia.
2. All Jay R. Smith hydrants are manufactured with "NO LEAD" brazing rings and USDA approved lubricants.
3. Dimensions shown in parentheses are in millimeters.
4. Lead Free Construcion/Materials.
5. The AB100, AB1953, California Lead Law, and NSF/ANSI Standard 61- Drinking Water System Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
6. **FOR IRRIGATION PURPOSES ONLY.**
7. Temperature Range: 33.0°F to 140.0°F (0.6°C to 60.0°C).

**REGULARLY FURNISHED:**

All Bronze Warm Climate Hydrant with Chrome Plated Face, Hose Connection having an Integral ASSE 1011 Vacuum Breaker, 360° Swivel Inlet Connection. Stainless Steel Box for 6"(150) Cored Hole and "T" Handle Key.

**VARIATIONS:**

- Cylinder Lock -CL
- "Water" on Cover -W
- (2) 3/8"(10) Tappings -TAP

A small amount of water seepage may occur from the vacuum breaker and operating screw upon initial opening and closing of the hydrant. This is normal operation.

DRAWING NUMBER s5518-R  
 SIZE A  
 SCALE: NONE  
 DATE: 6-21-11  
 APPROVED BY: CL  
 CHECKED BY: CL  
 DRAWN BY: TBW  
 5518-R  
 DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE  
 P  
 N  
 M  
 L  
 REV. DATE DESCRIPTION BY CKD. BY

P	2-3-25	Revised Notes	HS	CL	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER <b>5518-R</b>
N	8-1-23	Removed Function	HS	CL			
M	3-22-23	Added Notes 5 & 6/Removed ASL/TL	KK	JT			
L	3-8-23	Added -TPS to Variations	KK	CL			
REV.	DATE	DESCRIPTION	BY	CKD. BY			