

ADJUSTABLE FIXTURE SUPPORTS FOR SIPHON JET WATER CLOSETS

DRAWING NUMBER
s0210, 0220 -M58-M54

SIZE
A

SCALE:
NONE

DATE:
4-21-23

APPROVED BY:
CL

CHECKED BY:
CL


DRAWN BY:
KK

0210 -M58-M54
0220 -M58-M54

FIGURE NUMBER

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA


DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

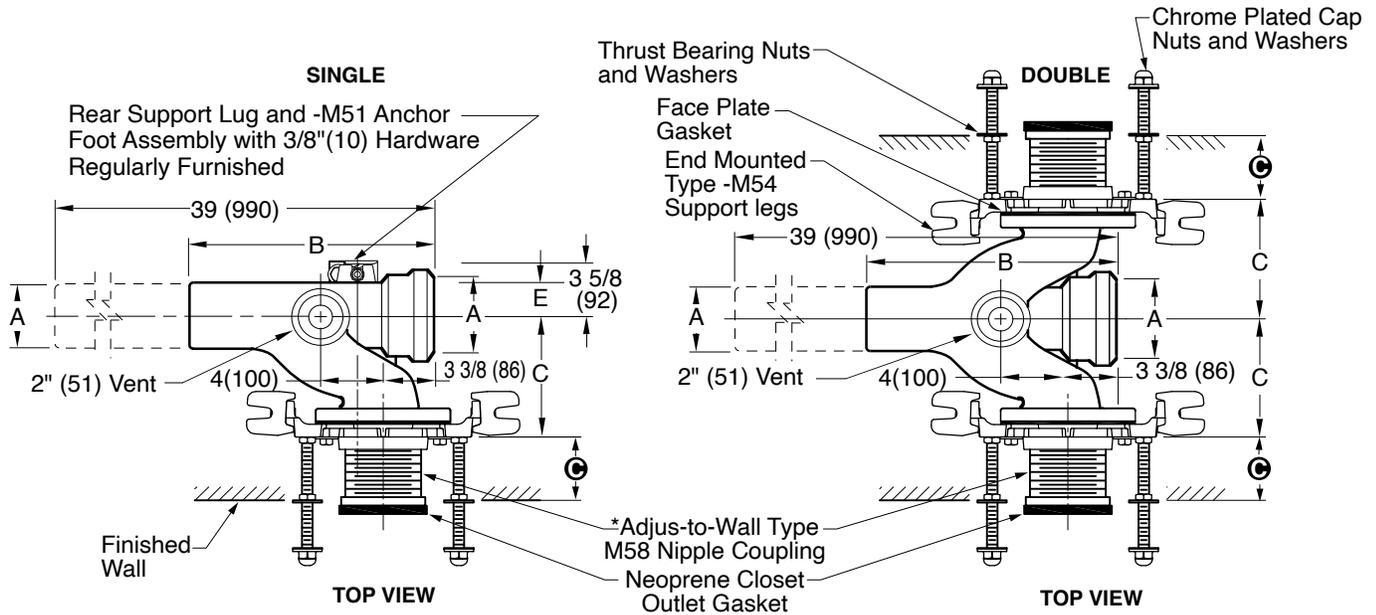

A SIZE	B	C	D		E
			MIN	MAX	
4 (100)	16 (405)	7 (180)	5/8 (16)	3 3/8 (86)	3 (76)
5 (125)	15 1/2 (395)	9 (230)	5/8 (16)	3 3/8 (86)	3 1/2 (89)

NOTES:

1. Base Support must be securely anchored to the floor (with one 1/2"(13) bolt per base support provided by installer.)
2. All single supports shall have the rear support lug anchored by contractor to assure a rigid installation. The rear support completes the 3 point anchoring system for ultimate stability of the installation.
3. Dimensions shown in parentheses are in millimeters.
4. *Dimension to top of vent.

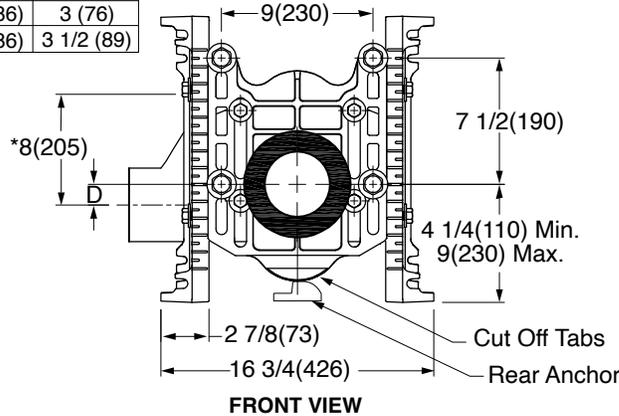


Conforms with the requirements of ASME A112.6.1M up to a 500 lbs (227kg) static load rating.

*LENGTH	MIN	MAX
10(255)	8 3/4"(222)	9 3/4"(247)

*NOTE: When nipple lengths between 3 1/4"(83) and 9 3/4"(247) are specified, the 10"(255) nipple will be supplied. The threaded end of nipple must be cut to specified length by others.

Fig. 0210L -M58-M54	CAULK Left Hand
Fig. 0210R -M58-M54	CAULK Right Hand
Fig. 0210D -M58-M54	CAULK Double
Fig. 0220L -M58-M54	CAULK Left Hand Long Barrel
Fig. 0220R -M58-M54	CAULK Right Hand Long Barrel
Fig. 0220D -M58-M54	CAULK Double Long Barrel

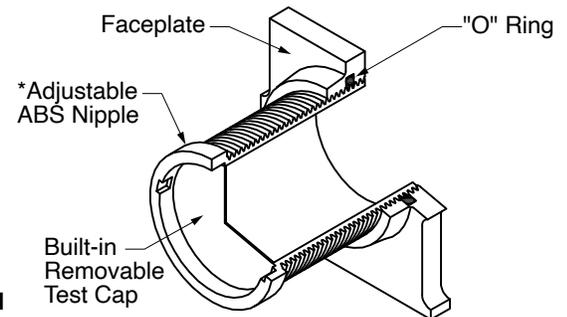

*ABS (Regularly Furnished)

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER
A	2-16-22	Rev. Drawing	KK	CL			0210 -M58-M54 0220 -M58-M54