




**NOTE:**

- 1- PLUG-IN TRANSFORMER INCLUDES BUILT-IN SECONDARY FUSE. IN THE EVENT OF POWER SURGE TRANSFORMER MAY REQUIRE REPLACEMENT.
- 2- ELECTRICAL RECEPTACLE MUST BE WIRED TO A GFI PROTECTED CIRCUIT. FIXTURE MUST BE EARTH GROUNDED PER N.E.C. (NATIONAL ELECTRICAL CODE).
- 3- PROVIDE 3-HOLE, 4" CENTRESET DECK OPENINGS WITH  $\phi 1"$  MINIMUM TO  $\phi 1\frac{1}{2}"$  MAXIMUM HOLES FOR FAUCET INSTALLATION.

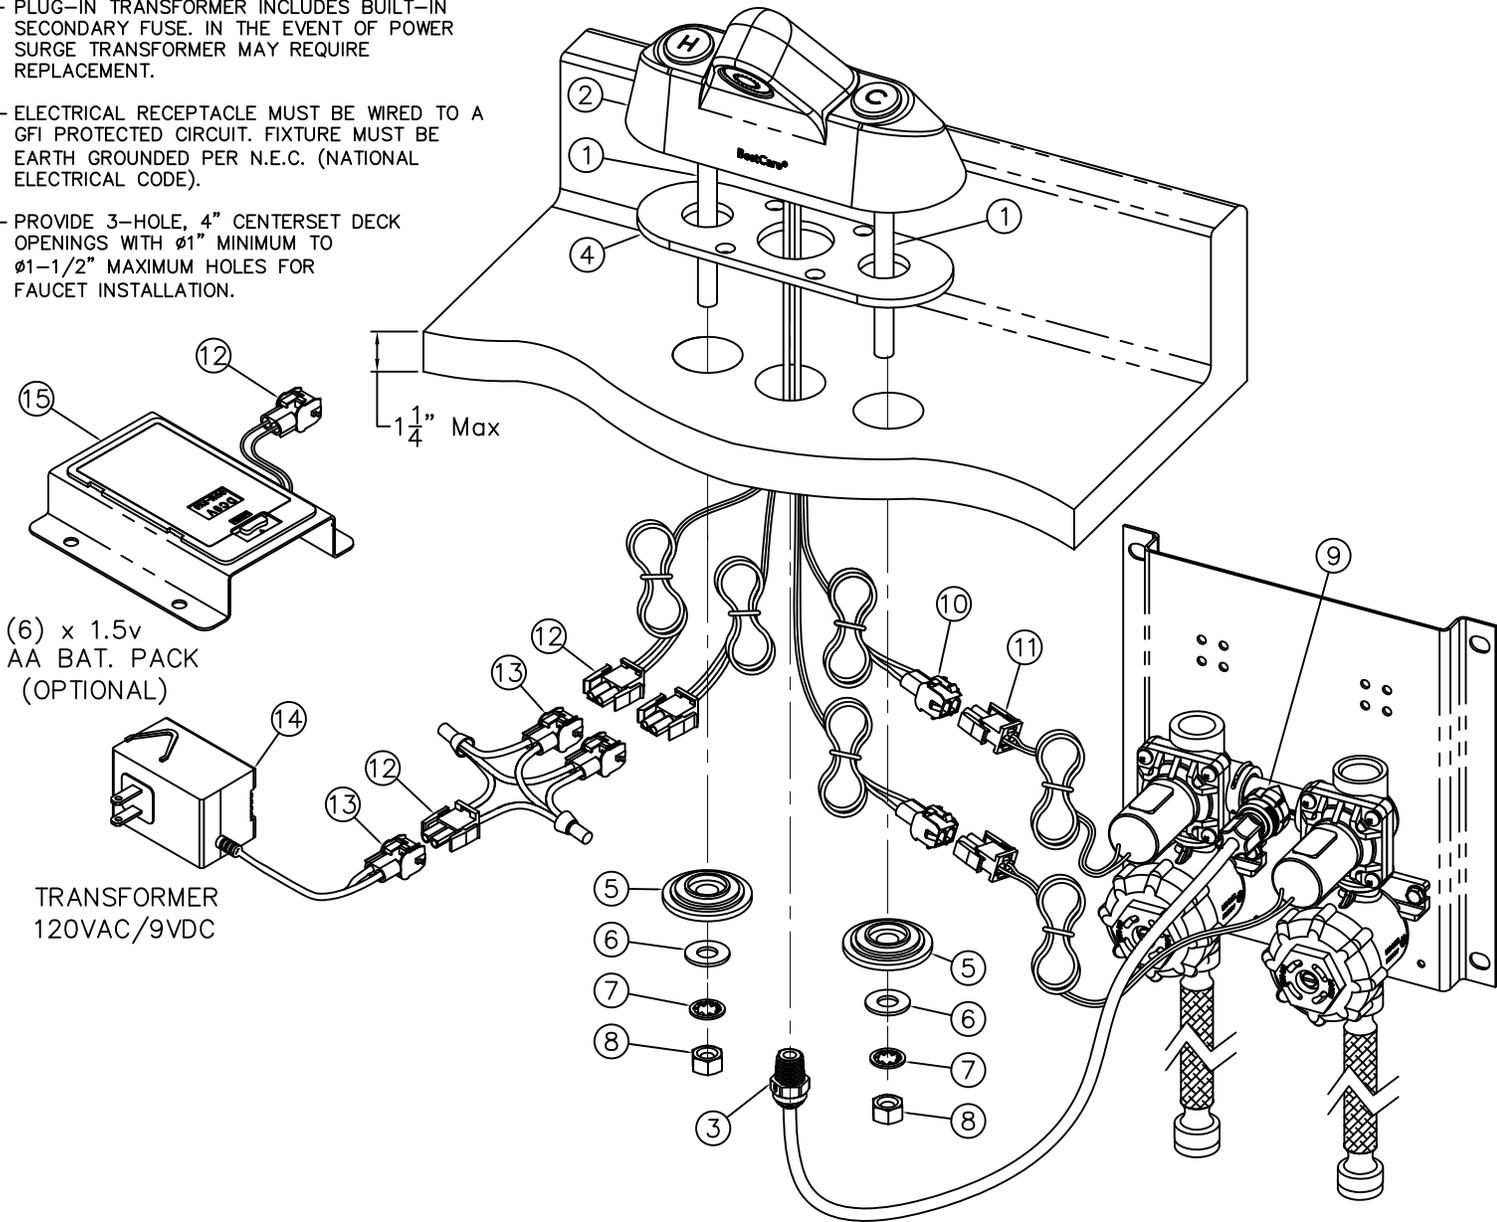

**INSTALLATION INSTRUCTIONS:**

- A- INSTALL THE THREADED ROD (1) FROM THE HARDWARE PACKAGE TO THE FAUCET ASSEMBLY (2).
- B- APPLY TEFLON TAPE TO THE 1/4" NPT FITTING (3) THEN INSTALL INTO THE FAUCET ASSEMBLY.
- C- FEED THE FAUCET ASSEMBLY WIRES THROUGH THE CENTER HOLE AND MOUNT FAUCET ASSEMBLY (2) AND GASKET (4) ON THE BASIN AND FASTEN USING THE PROVIDED STEP WASHERS (5), FLAT WASHERS (6), LOCK WASHERS (7) AND HEX NUTS (8).
- D- CONNECT THE 1/4" POLYETHYLENE WATER LINE TO THE VALVE ASSEMBLY (9); HAND TIGHTEN FERRULE NUT.

- E- CONNECT THE WHITE SOLENOID CONNECTORS (10) AND (11) TOGETHER. CONNECT THE RED POWER SUPPLY CONNECTORS (12) AND (13) TOGETHER.
- F- AFTER THOROUGHLY FLUSHING SUPPLY LINES, MAKE-UP CONNECTIONS TO VALVE ASSEMBLY INLET(S) (USE FLEXIBLE INLET HOSE) CONNECT TO 1/2" NPT SUPPLY.

**NOTE: AN APPROVED WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 MUST BE PROVIDED FOR THE HOT/TEMPERED SIDE OF THIS VALVE.**

**WHITEHALL MANUFACTURING**  
 P.O. BOX 3527 Industry, CA 91744  
 15125 Proctor Ave Industry, CA 91746  
 (626) 968-6681 FAX (626) 855-4862

<b>TITLE</b>		
<b>LIGATURE RESISTANT FAUCET *WH3378-HC-PPZ/-BAT</b>		
MANUFACTURE DATE	DATE ISSUED	DRAWING NUMBER
<b>MAY 2019</b>	<b>05/19/19</b>	<b>9918-080-001</b>
<b>TO PRESENT</b>	DATE REVISED <b>05/22/19    A</b>	