

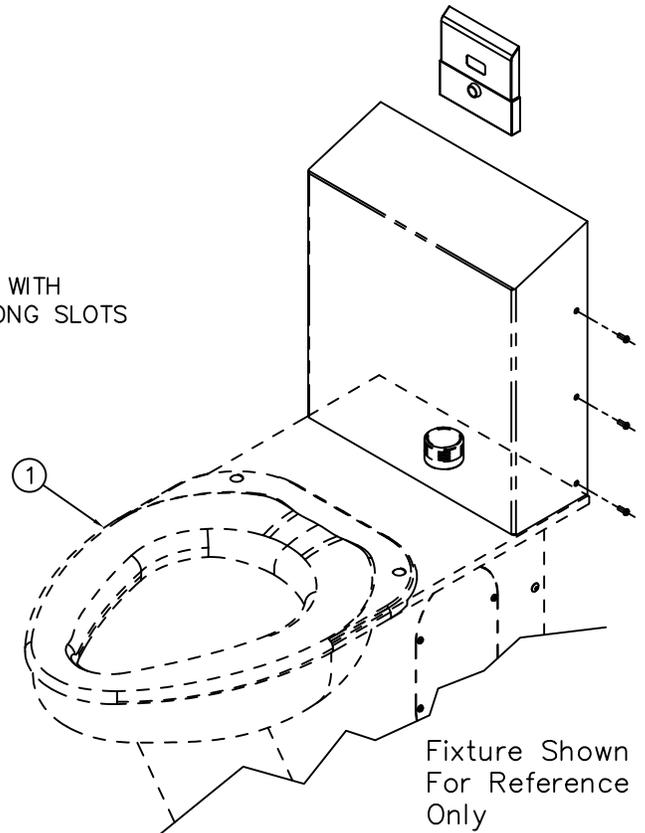


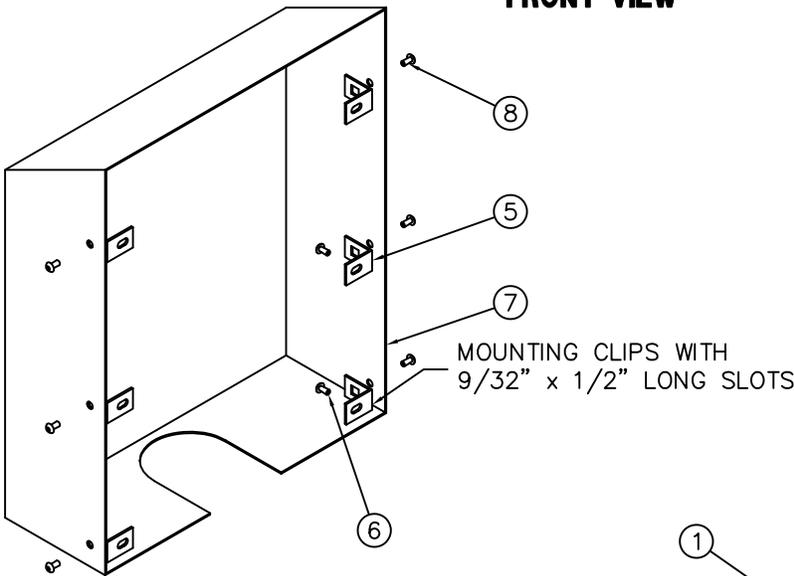

REFERENCE DRAWINGS	
SECURITY SCREWS	9951-005-W01
TINNERMAN NUTS	9951-007-W01

NOTE:
 120/24 VAC TRANSFORMER PROTECTED WITH A GFCI IS REQUIRED AND SHALL BE PROVIDED BY OTHERS.
 REFER TO FLUSH VALVE MANUFACTURE'S COMPLETE INSTALLATION INSTRUCTIONS FOR DETAILS.
 CHECK LOCAL ELECTRICAL CODE REQUIREMENTS TO ENSURE COMPLIANCE.

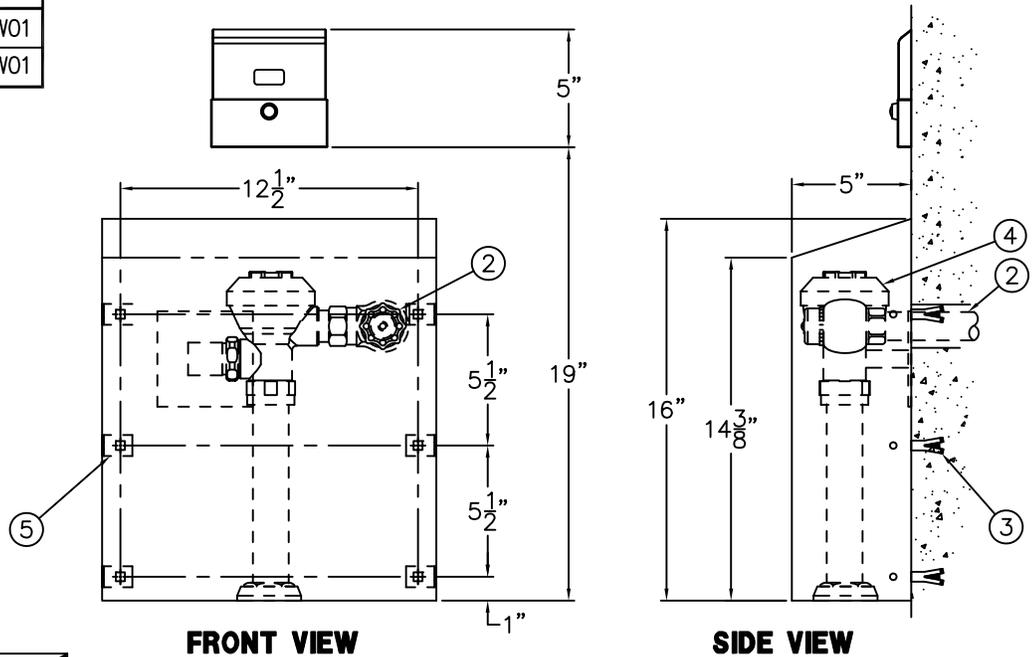

INSTALLATION INSTRUCTIONS:

- A- INSTALL TOILET ① PER FIXTURE INSTALLATION INSTRUCTION.
- B- ROUGH-IN FOR FLUSH VALVE SUPPLY ② REFER TO FLUSH VALVE INSTALLATION INSTRUCTIONS.
- C- LOCATE AND INSTALL WALL ANCHORS (BY OTHERS) ③.
- D- INSTALL FLUSH VALVE ④ TO FIXTURE ①.
- E- ATTACH MOUNTING CLIPS ⑤ TO WALL USING MOUNTING SCREWS ⑥ (BY OTHERS).
- F- ATTACH FLUSH VALVE COVER ⑦ TO MOUNTING CLIPS ⑤ USING #10-32 SCREWS ⑧ PROVIDED.

WHITEHALL MANUFACTURING P.O. BOX 3527 Industry, CA 91744 15125 Proctor Ave Industry, CA 91746 (626) 968-6681 FAX (626) 855-4862	TITLE SENSOR OP, LIGATURE RESISTANT FV COVER WITH FLUSH VALVE (TOILET) •WH2802SLPT-SO		
	MANUFACTURE DATE MAY 2019 TO PRESENT	DATE ISSUED 05/01/2019 DATE REVISED 10/03/2022	DRAWING NUMBER 9918-018-001