




NOTE: AN APPROVED WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070 MUST BE PROVIDED FOR THE HOT/TEMPERED SIDE OF THIS VALVE.

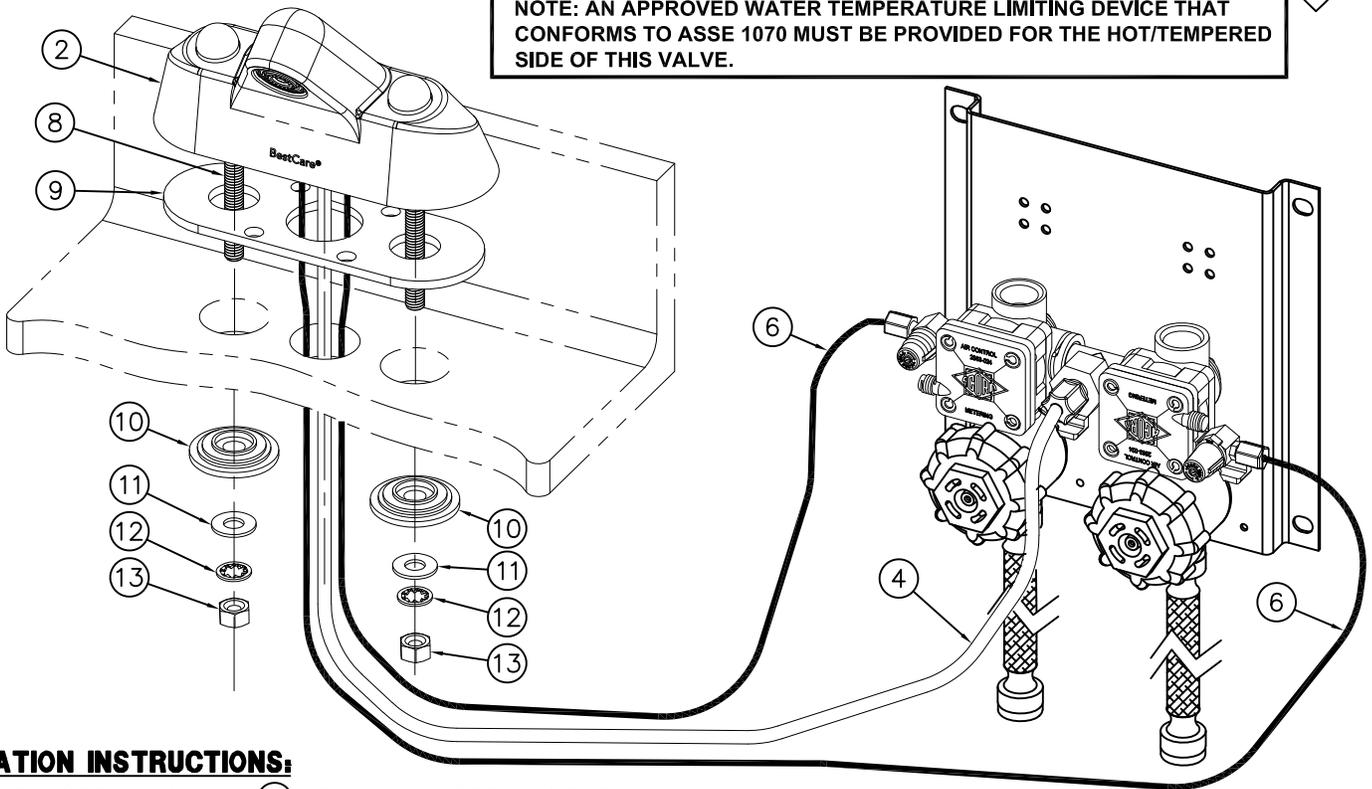

INSTALLATION INSTRUCTIONS:

A- REMOVE BOTTOM PLATE (1) FROM FAUCET ASSEMBLY (2) BY REMOVING SCREWS (3) TO EXPOSE AIR AND WATER TUBE CONNECTIONS.

B- AND INSERT 1/4" O.D. RISER TUBE (4) INTO PUSH-FITTING (5), THEN INSERT 1/8" O.D. AIR TUBE (6) INTO PUSHBUTTON TUBE (7). GUIDE ALL TUBES THROUGH THE BOTTOM PLATE (1) AND REATTACH BOTTOM PLATE (1) TO FAUCET ASSEMBLY (2) WITH SCREWS (3).

NOTE: RED 1/8" O.D. TUBE TO LEFT PUSH BUTTON AND BLUE 1/8" O.D. TUBE TO RIGHT PUSHBUTTON.


C- INSTALL THE THREADED ROD (8) FROM THE HARDWARE PACKAGE TO THE BOTTOM PLATE (1).

D- GUIDE THE AIR AND WATER TUBING THROUGH THE CENTER HOLE OF BASIN AND MOUNT FAUCET ASSEMBLY (2) AND GASKET (9) ON THE BASIN AND FASTEN USING THE PROVIDED STEP WASHERS (10), FLAT WASHERS (11), LOCK WASHERS (12) AND HEX NUTS (13).

E- CONNECT 1/8" O.D. AIR LINE (6) FROM PUSHBUTTON ASSEMBLY TO VALVE TIMER ASSEMBLY. HAND TIGHTEN FERRULE NUT PROVIDED.

F- CONNECT 1/4" O.D. WATER LINE (4) TO VALVE. HAND TIGHTEN FERRULE NUT PROVIDED.

G- AFTER THOROUGHLY FLUSHING SUPPLY LINES MAKE -UP CONNECTIONS TO VALVE ASSEMBLY INLET(S) 1/2" NPTE OR 1/2" NPS FLEX HOSE AS REQUIRED.

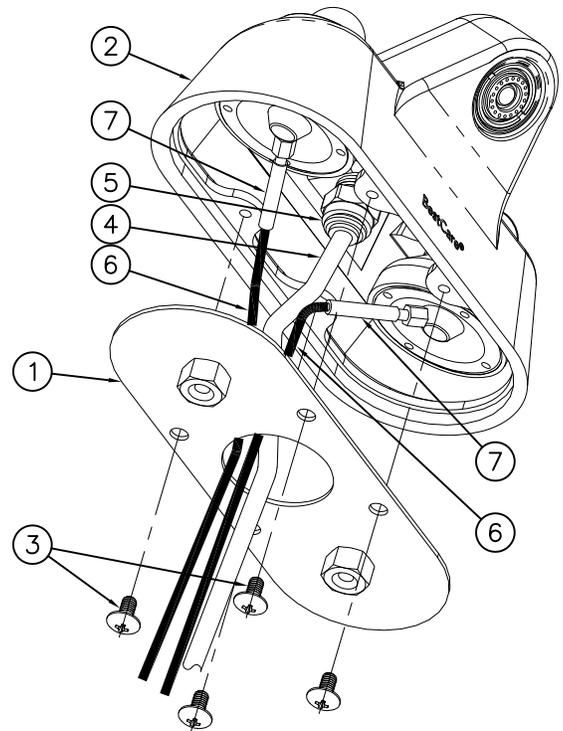

DETAIL NOT TO SCALE



WHITEHALL MANUFACTURING
P.O. BOX 3527 Industry, CA 91744
15125 Proctor Ave Industry, CA 91746
(626) 968-6681 FAX (626) 855-4862

TITLE LIGATURE RESISTANT FAUCET *WH3378-HC		
MANUFACTURE DATE MAY 2019	DATE ISSUED 05/20/19	DRAWING NUMBER 9918-081-001
TO PRESENT	DATE REVISED	