



**NOTE:**  
 Cabinet weight  
 (without extinguisher) is 35 lbs.  
 Recessed Cabinet Overall  
 Dimensions:  
 $10\frac{1}{2}''$ W x  $25\frac{1}{2}''$ T x  $3\frac{3}{4}''$  Depth

**MOUNTING DETAIL**

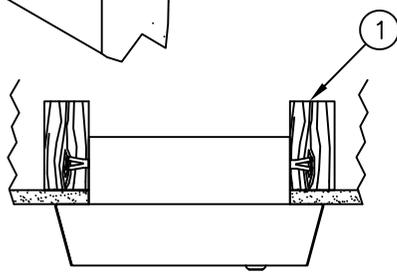

**TOP VIEW**

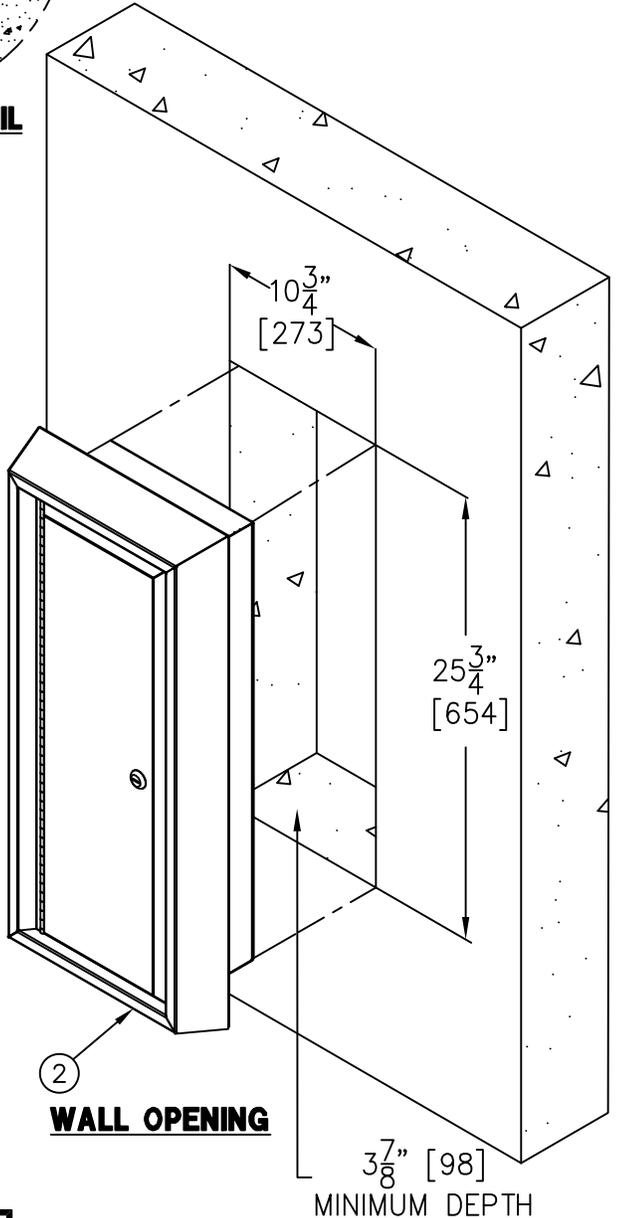

**WALL OPENING**

**INSTALLATION INSTRUCTIONS:**

- A. PROVIDE  $10\frac{3}{4}''$  X  $25\frac{3}{4}''$  WALL OPENING AND BACKING (1) TO ACCEPT CABINET. MINIMUM  $3\frac{7}{8}''$  DEPTH FROM FINISHED WALL.
- B. NOTE: FOR FIRE RATED WALL, MAX GAP BETWEEN CABINET AND WALL BOARD SHALL BE  $\frac{1}{8}''$ . VERIFY ALL OTHER REQUIREMENTS FOR RATED WALL PENETRATIONS.
- C. DRILL HOUSING (2) TO LOCATE MOUNTING POINTS WHERE BACKING EXISTS. REMOVE HOUSING (2) AND INSTALL WALL ANCHORS (3) (BY OTHERS) AS REQUIRED FOR WALL/TYPE BACKING.
- D. INSTALL EXTINGUISHER CABINET HOUSING (2) INTO WALL OPENING (1).
- E. FASTEN HOUSING (2) INTO WALL USING SCREWS TO SUIT WALL CONSTRUCTION (BY OTHERS).

**IMPORTANT!** AFTER INSTALLATION, ALL JOINTS REQUIRE SECURITY SEALANT BY INSTALLER TO ELIMINATE GAPS BETWEEN WALL AND FIXTURE.

LOCATE ITEM TO CONFORM WITH APPLICABLE CODES FOR ACCESSIBILITY. 

 WHITEHALL MANUFACTURING P.O. BOX 3527 Industry, CA 91744 15125 Proctor Ave Industry, CA 91746 (626) 968-6681 FAX (626) 855-4862	<b>TITLE</b> <b>FIRE RATED LR SEMI-RECESSED FIRE EXTINGUISHER CABINET WH1724-FR</b>		
	<b>MANUFACTURE DATE</b> <b>JUNE 2024</b> <b>TO PRESENT</b>	<b>DATE ISSUED</b> <b>6/11/2024</b>	<b>DRAWING NUMBER</b> <b>9918-138-001</b>