

SOLIDS INTERCEPTORS

FLUSH WITH FLOOR OR ON THE FLOOR TYPE

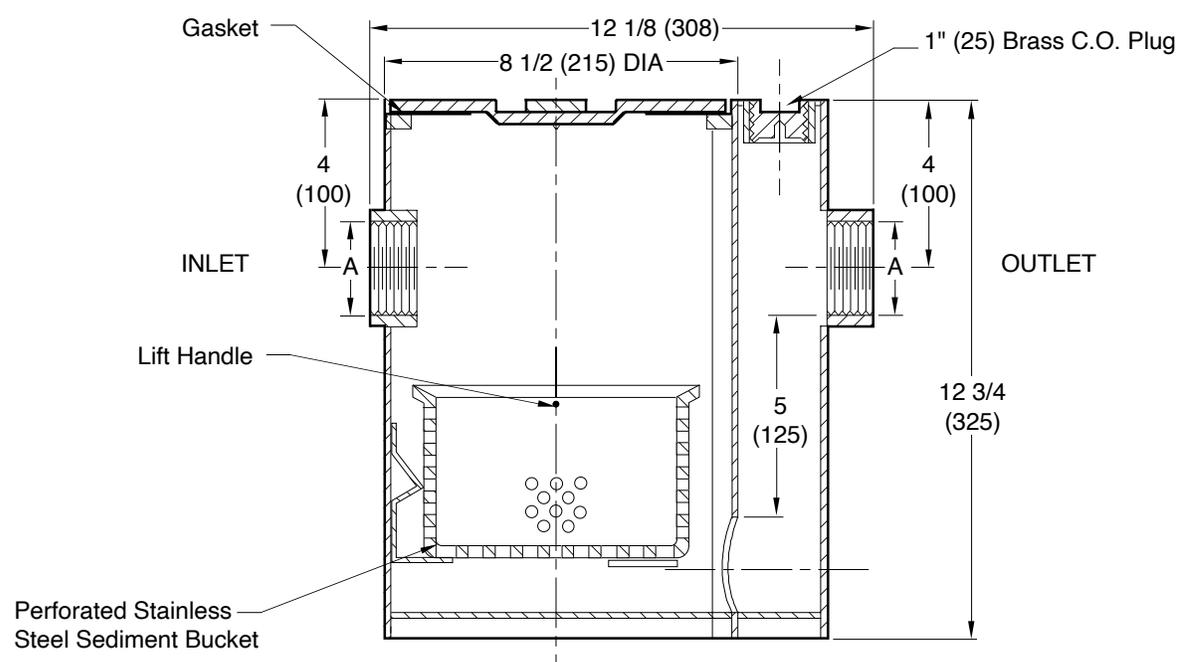


Fig. 8714T
A(Pipe Size) = 0150(40) or 02(50)

NOTE: It is the responsibility of the installer to check all parts (internal and external) to verify they are in their proper operating order and location.

NOTE: Allow 4 1/2" (115) above interceptor for removal of basket.

REGULARLY FURNISHED:
 Fabricated Steel Body with Galvanized Sub-Coat with White Duco Finish Inside and Outside and Stainless Steel Perforated Bucket and Aluminum Cover.

VARIATIONS:
 Fine Mesh Screen
 Bucket Liner

OPTIONAL MATERIALS:
 Acid Resistant Coating Inside - ARI
 Acid Resistant Coating Outside - ARO
 Acid Resistant Coating Inside and Outside - ARIO
 All Stainless Steel Fabricated Body and Cover - SS

NOTE: Dimensions shown in parentheses are in millimeters.

DRAWING NUMBER S8714
 SIZE A
 SCALE: NONE
 DATE: 4-24-85
 APPROVED BY: SJM
 CHECKED BY: CR
 DRAWN BY: RH
 DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

8714

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 8714