




**Fire Rated Ligature Resistant  
 Semi-Recessed Fire Extinguisher Cabinet**

The BestCare® Fire Rated Fire Extinguisher Cabinets are designed to provide utility while ensuring patient's safety. Semi-Recessed Cabinets are Fire Rated by Underwriters Laboratories Inc., for ANSI/UL 1479, CAN/ULC-S115 (1995), for 2 hours in walls. Cabinet includes sloping edges that protrude 2-3/4" from the surface. Door and Trim are 20 gage steel. The cabinet doors are attached with a continuous hinge and equipped with a cylinder lock. The tub is constructed of 20 gage steel. All components are powder coated with an electrostatically-applied, thermally-fused, re-coatable white polyester finish.

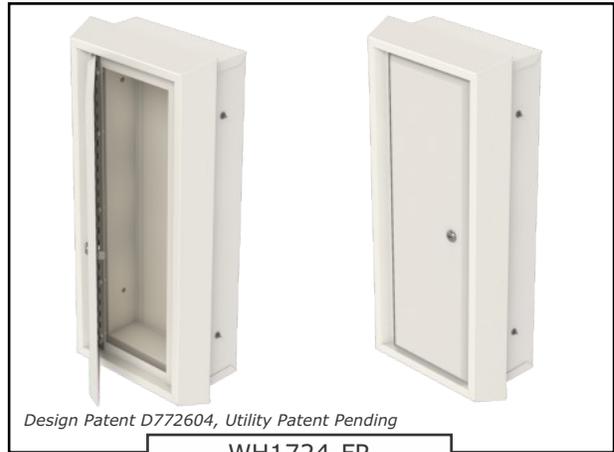


Design Patent D772604, Utility Patent Pending

WH1724-FR

**MODEL NUMBER AND OPTIONS SELECTION:**

**BASE MODEL NUMBER**

WH1724-FR Ligature Resistant Semi-Recessed Fire Extinguisher Cabinet

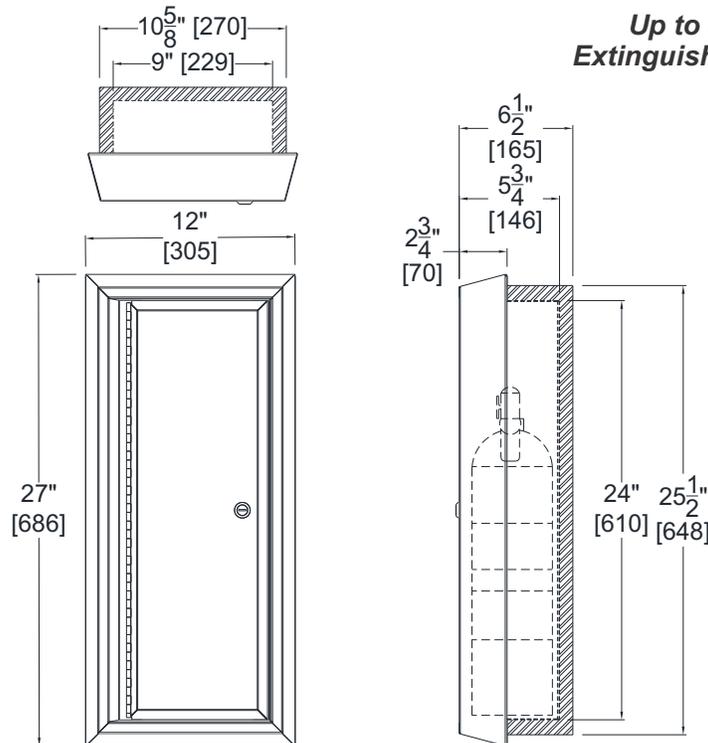

**DISCLAIMER:**

This product is designed to decrease the probability that it may be utilized as an apparatus for ligature. It is not a replacement for professionals who are trained in the proper evaluation, management and supervision of persons at risk of suicide.

**⚠ WARNING: Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)**

**SELECTION SUMMARY & APPROVAL FOR MANUFACTURING**

Model Number & Options \_\_\_\_\_ Quantity \_\_\_\_\_  
 Company \_\_\_\_\_ Date \_\_\_\_\_  
 Contact \_\_\_\_\_ Title \_\_\_\_\_  
 Approval for Manufacturing/Signature \_\_\_\_\_

All dimensions are nominal and subject to manufacturer's change without notice. Whitehall assumes no responsibility for use of void or superseded data © Whitehall Manufacturing, Member of Morris Group International. Please visit [www.whitehallmfg.com](http://www.whitehallmfg.com) for most current specifications.