

# MILD CLIMATE ANTI-SIPHON SILLCOCK

## BOX TYPE WITH CONCEALED HOSE CONNECTION DUAL CHECK VALVE - BACKFLOW PROTECTED

DRAWING NUMBER: s5572 (-BFP), 5573 (-BFP)

SIZE: A

SCALE: NONE

DATE: 7-7-11

APPROVED BY: CL


CHECKED BY: CL

DRAWN BY: TBW

FIGURE NUMBER: 5572 (-BFP), 5573 (-BFP)

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

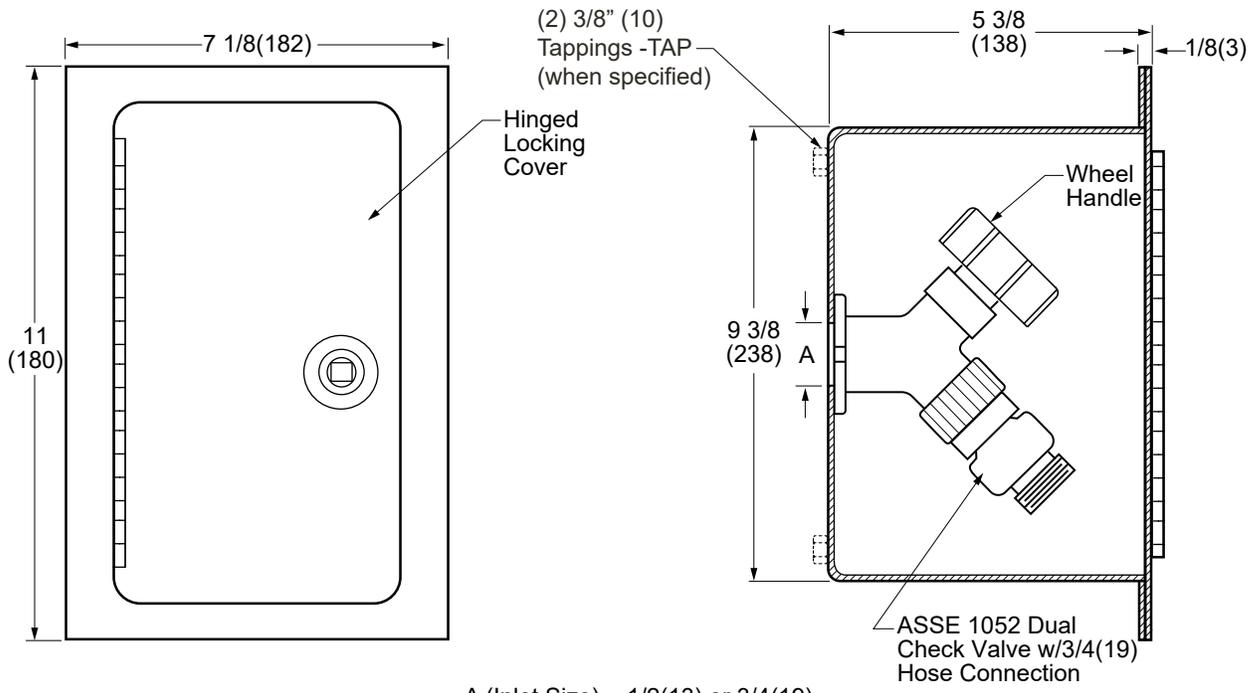

A (Inlet Size) = 1/2(13) or 3/4(19)

- Fig. 5572 (-BFP).....1/2"(13) Female NPT Inlet
- Fig. 5573 (-BFP).....3/4"(19) Female NPT Inlet

**NOTES:**

1. Recommended wall opening 9 3/4"(250) x 6"(150).
2. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to Jay R. Smith hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
3. The Dual Check Valve may discharge water to prevent backflow. Do Not install where spillage may cause water damage.
4. Dimensions shown in parentheses are in millimeters.
5. **FOR IRRIGATION PURPOSES ONLY.**

**REGULARLY FURNISHED:**

Hose Valve has a Rough Finish Brass Body Removable Wheel Handle, "T" Handle Key, NPT Female Threaded Inlet Size Indicated by Figure Number Selected, ASSE 1052 Dual Check Valve with 3/4"(19) Hose Connection and Stainless Steel Box with Full 180° Cover Opening.

**VARIATIONS:**

- (2) 3/8"(10) Tappings -TAP
- Cylinder Lock -CL

Installer is responsible for providing a 100% watertight positive seal at the hydrant to box interface and hydrant to wall interface. Seal all interior joints, seams, gasket seams/closures including around the hydrant box flange with an appropriate sealant recommended by a sealant manufacturer. NOTE: Jay R. Smith does not warrant the performance or life expectancy of the sealant material.

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	<b>FIGURE NUMBER</b> <b>5572 (-BFP)</b> <b>5573 (-BFP)</b>