

# SOLIDS INTERCEPTORS

## FLUSH WITH FLOOR OR ON THE FLOOR TYPE

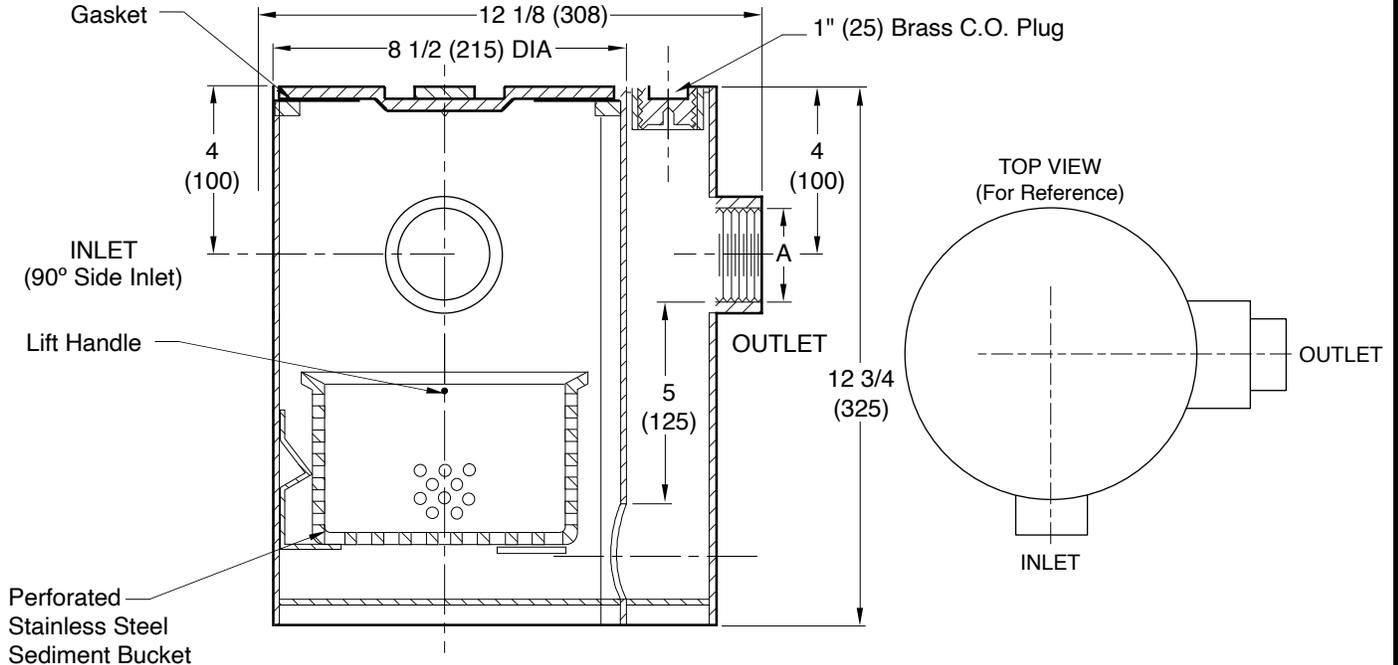


Fig. 8714T  
 A(Pipe Size) = 0150(40) or 02(50)

**NOTE:** It is the responsibility of the installer to check all parts (internal and external) to verify they are in their proper operating order and location.

**NOTE:** Allow 4 1/2" (115) above interceptor for removal of basket.

**REGULARLY FURNISHED:**  
 Fabricated Steel Body with Galvanized Sub-Coat with White Duco Finish Inside and Outside with 90° Side Inlet and Stainless Steel Perforated Bucket and Aluminum Cover.

**VARIATIONS:**  
 Fine Mesh Screen  
 Bucket Liner

**NOTE:** Dimensions shown in parentheses are in millimeters.

**OPTIONAL MATERIALS:**  
 Acid Resistant Coating Inside - ARI  
 Acid Resistant Coating Outside - ARO  
 Acid Resistant Coating Inside and Outside - ARIO  
 All Stainless Steel Fabricated Body and Cover - SS

DRAWING NUMBER  
**S8714-56**

SIZE  
**A**

SCALE:  
**NONE**

DATE:  
**8-30-07**

APPROVED BY:  
**ECW**

CHECKED BY:  
**BW**

DRAWN BY:  
**RH**

**8714-56**

FIGURE NUMBER

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

<b>A</b>	<b>7-28-23</b>	<b>Removed Function</b>	<b>HS</b>	<b>CL</b>	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER <b>8714-56</b>
REV.	DATE	DESCRIPTION	BY	CKD. BY			