SMITH FLUID CONTROLS®

JAY R. SMITH MFG. CO.®
MEMBER OF MORRIS GROUP INTERNATIONAL
POST OFFICE BOX 3237
MONTGOMERY, ALABAMA 36109-0237 (USA)
TEL: 334-277-8520 FAX: 888-377-7818 www.jrsmith.com

LOCATION

ELECTRONIC TRAP PRIMING DEVICE

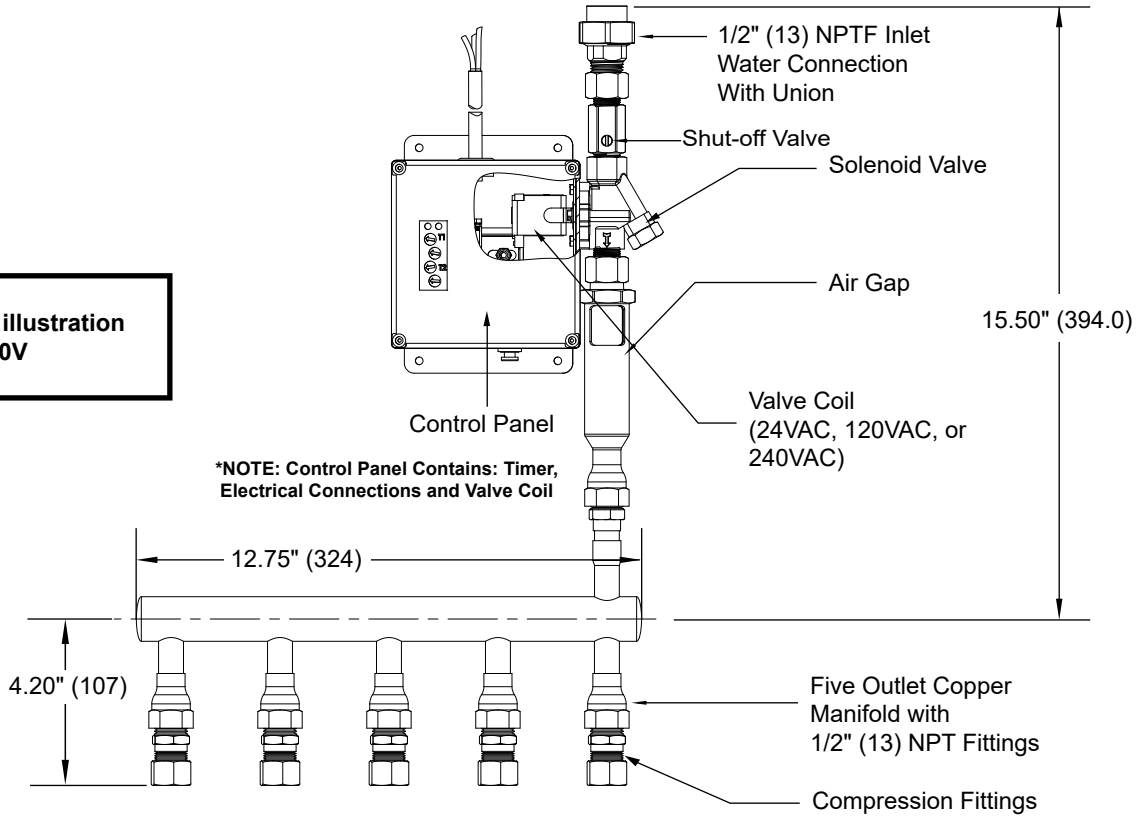

Shown in illustration 273-05-120V

- ☐ **273-05-24VAC (1/2" (13) NPTF Inlet / 1/2" (13) NPTF Outlet), (Required: Hard Wire Connection)**
- ☐ **273-05-120VAC (1/2" (13) NPTF Inlet / 1/2" (13) NPTF Outlet)**
- ☐ **273-05-240VAC (1/2" (13) NPTF Inlet / 1/2" (13) NPTF Outlet), (Required: Hard Wire Connection)**

- **Working Pressure -20 PSI (138 kPa) to 100 PSI (689 kPa)**

REGULARLY FURNISHED:

A floor drain trap priming device consisting of a solenoid valve, brass air gap, and a hard wire connection.

NOTES:

- For 240VAC and 24VAC, the power supply cord will require hard wire installation. For 120VAC Wall Plug Included.
- Wiring must follow and be in accordance with National, State and Local Electrical Codes.
- The outlet of the trap primer valve shall be a minimum of 12 inches (305) above the finished floor before a 90° elbow can be installed. See installation instructions.
- Dimension shown in parenthesis are millimeters unless specified otherwise.
- Unit must be installed level and be accessible.

REV.	DATE	DESCRIPTION	BY	CKD. BY
F	12-5-23	Revised Notes	HS	CL
E	10-9-23	Removed Function	HS	CL
D	5-17-23	Labeled Shut-off Valve	HS	CL
C	4-5-21	Added control panel note	KK	JM

WEIGHT POUNDS

VOLUME CUBIC FEET

FIGURE NUMBER **273-05 SERIES**

FIGURE NUMBER **273-05 SERIES** | DRAWN BY: **WAS** | CHECKED BY: **JM** | APPROVED BY: **JM** | DATE: **11-6-20** | SCALE: **NONE** | SIZE **A** | DRAWING NUMBER **s273-05 SERIES** | **F**

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov