


ADJUSTABLE FIXTURE SUPPORTS

SHALLOW ROUGH-IN TYPE FOR BLOWOUT WATER CLOSETS


NO-HUB HORIZONTAL FITTINGS

SINGLE

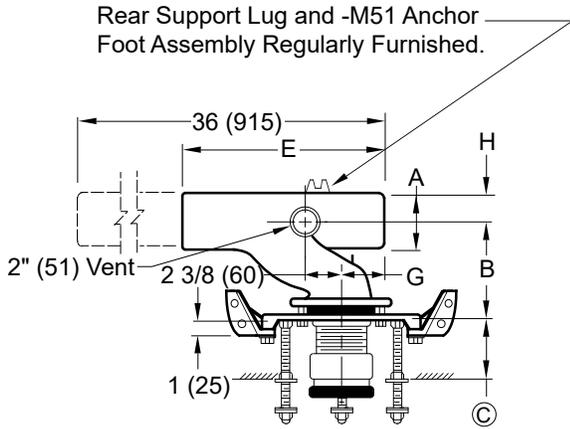

**Fig. 0310RY
Top View**


DOUBLE

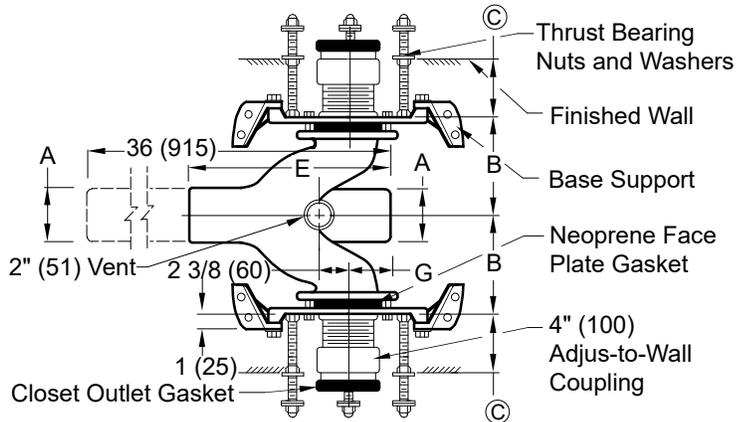

**Fig. 0310DY
Top View**

- Fig. 0310LY NO-HUB LEFT HAND
- Fig. 0310RY NO-HUB RIGHT HAND
- Fig. 0310DY NO-HUB DOUBLE
- Fig. 0320LY NO-HUB L.H. LONG BARREL
- Fig. 0320RY NO-HUB R.H. LONG BARREL
- Fig. 0320DY NO-HUB DOUBLE LONG BARREL

NOTE: When used with concealed flush valve locate face plate behind supply pipe.
NOTE: Base support must be securely anchored to floor with four 1/2" (13) bolts provided by contractor.
NOTE: See opposite side for © dimension and optional outlet connections.

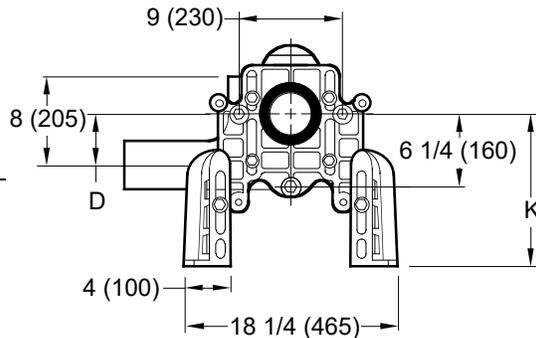

**BLOWOUT
Front View**

A SIZE	B	D		E	G	H	K	
		BLOWOUT MIN	MAX				BLOWOUT MIN	MAX
4 (100)	7 (180)	1 7/8 (48)	4 3/4 (120)	14 (355)	3 3/8 (89)	3 (76)	10 3/4 (275)	15 3/4 (400)

The water closet gasket regularly furnished is made of molded neoprene and designed to fit water closet outlet dimensions and configurations shown in ANSI Standard A112.19.2M-1982, Figure 13B. If gasket is not found to be compatible to fixture due to nonconformance of said fixture to ANSI A112.19.2M, then fixture manufacturer shall be consulted for a suitable gasket recommendation. Jay R. Smith assumes no liability for connections to fixtures which do not conform to these standards.

Conforms to ASME A112.6.1M

DRAWING NUMBER S0310Y
SIZE A
SCALE: NONE
DATE: 12-18-89
APPROVED BY: JD
CHECKED BY: CR
DRAWN BY: EMB
FIGURE NUMBER 0310Y, 0320Y

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

DIMENSIONS ARE SUBJECT TO MANUFACTURERS TOLERANCE AND CHANGE WITHOUT NOTICE

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 0310Y, 0320Y