

# MILD CLIMATE ANTI-SIPHON SILLCOCK

## DUAL CHECK VALVE - BACKFLOW PROTECTED

**FUNCTION:** For installation in interior and exterior wall locations of buildings that are not subject to freezing. Dual Check Valve prevents backflow due to low head pressure and conforms to the requirements of ASSE Standard 1052.

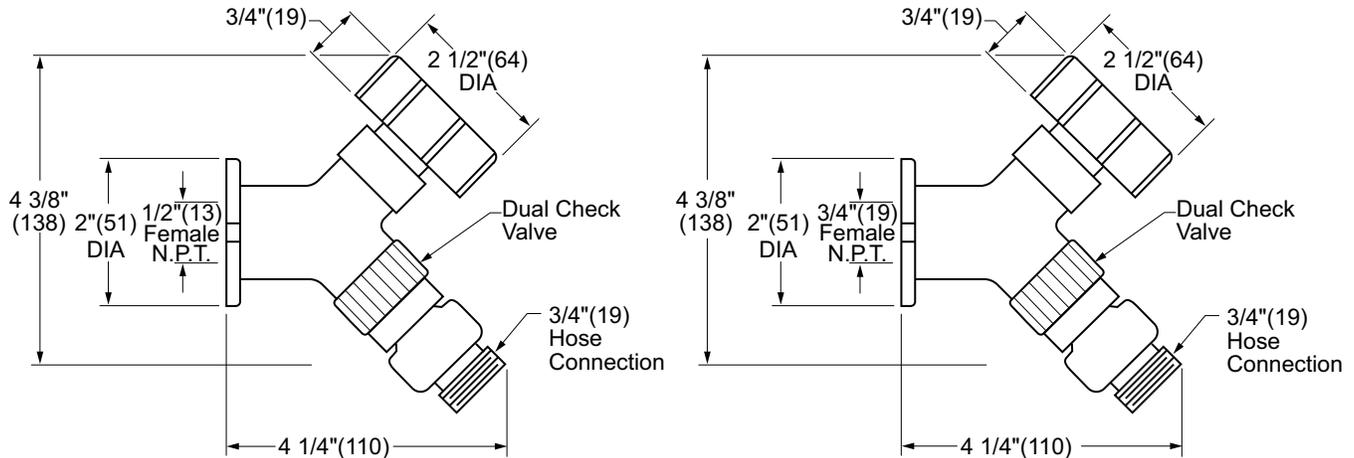


Fig. M-3672 (-BFP)..... 1/2"(13) Inlet

Fig. M-3673 (-BFP)..... 3/4"(19) Inlet

**NOTES:**

1. The AB1953, California Lead Law, and NSF/ANSI Standard 61-2008 - Drinking Water Components are not applicable to hydrants as they do not convey/dispense water for human consumption through drinking or cooking.
2. The Dual Check Valve may discharge water to prevent backflow. Do Not install where spillage may cause water damage.
3. Dimensions shown in parentheses are in millimeters.
4. **FOR IRRIGATION PURPOSES ONLY.**

**REGULARLY FURNISHED:**

Hose Valve has a Rough Finish Brass Body  
Removable Wheel Handle, "T" Handle Key,  
NPT Female Threaded Inlet Size Indicated  
by Figure Number Selected and ASSE 1052  
Dual Check Valve with 3/4"(19) Hose Connection.

**OPTIONAL MATERIALS:**

Rough Chrome Plated -CR

**⚠ WARNING: Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)**

|   |  |                |  |
|---|--|----------------|--|
| <b>SELECTION SUMMARY &amp; APPROVAL FOR MANUFACTURING</b> | Model Number & Options _____                 | Quantity _____ | All dimensions are subject to manufactures tolerance of plus or minus 1/2" nominal and subject to change without notice. Murdock assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. Murdock Mfg.™, Member of Morris Group International™. Please visit <a href="http://www.murdockmfg.com">www.murdockmfg.com</a> for most current specifications. |
|   | Company _____                                |                |  |
|   | Contact _____                                | Title _____    |  |
|   | Signature (Approval for Manufacturing) _____ | Date _____     |  |