

HEAVY DUTY SINK SUPPORTS

FLOOR MOUNTED WITH ACID RESISTANT COATED EXPOSED ARMS & "PRO-SET" UPRIGHTS


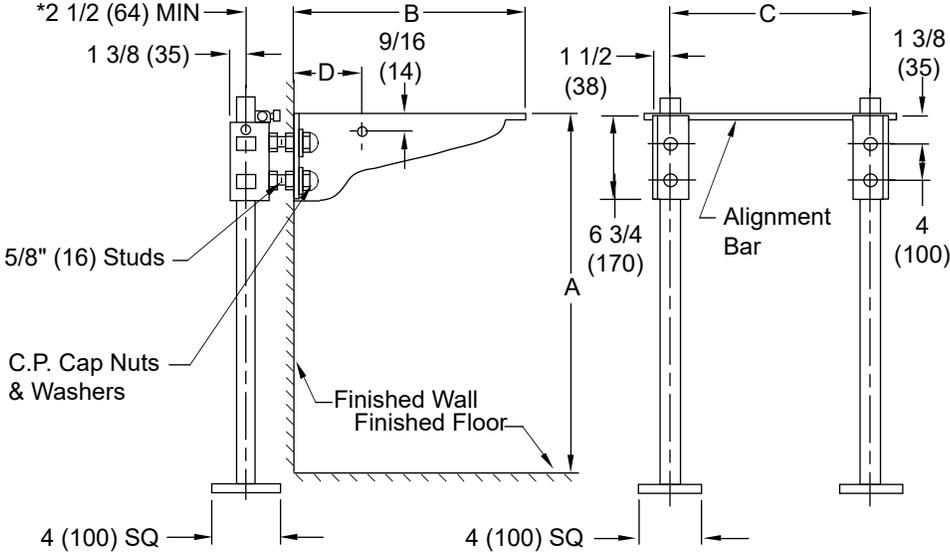


Fig. 0871 . . . WITH OFFSET ARMS FOR ENAMELED IRON SERVICE SINKS WITH CAST LUGS UNDER BASIN

*This dimension can be increased when fixture support is to be installed behind the wall (specify when required and wall thickness).

NOTE: Dimensions shown in parentheses are in millimeters.

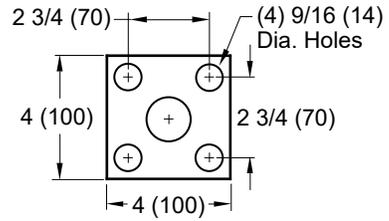

Conforms to ASME A112.6.1M.

ROUGHING-IN TABLE

FIXTURE NAME	NUMBER	SIZE	A	B	C	D

NOTE: The rough-in dimensions listed on this drawing are based on current information available to Jay R. Smith by the fixture manufacturers. We recommend that you verify these dimensions with the fixture manufacturer. We will not accept responsibility for rough-in dimension changes by the fixture manufacturer.

DRAWING NUMBER: **S0871 (B)**
 SIZE: **A**
 SCALE: **NONE**
 DATE: **10-30-63**
 APPROVED BY: **RP**
 CHECKED BY: **SL**
 DRAWN BY: **SL**
 FIGURE NUMBER: **0871**

WE CAN ASSUME NO RESPONSIBILITY FOR USE OF SUPERSEDED OR VOID DATA

REV.	DATE	DESCRIPTION	BY	CKD. BY	WEIGHT POUNDS	VOLUME CUBIC FEET	FIGURE NUMBER 0871