

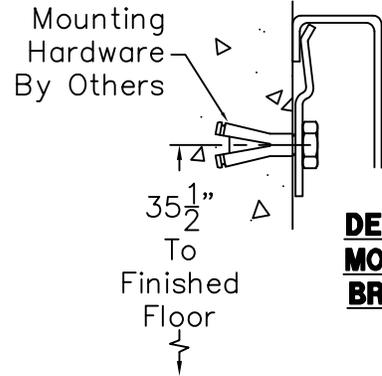



REFERENCE DRAWINGS	
Hot & Cold Valve	9908-105-002
Single Temp Valve	9908-106-002

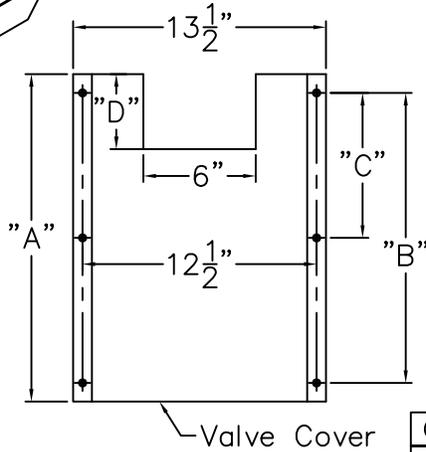

**DETAIL 'A'  
MOUNTING  
BRACKET**

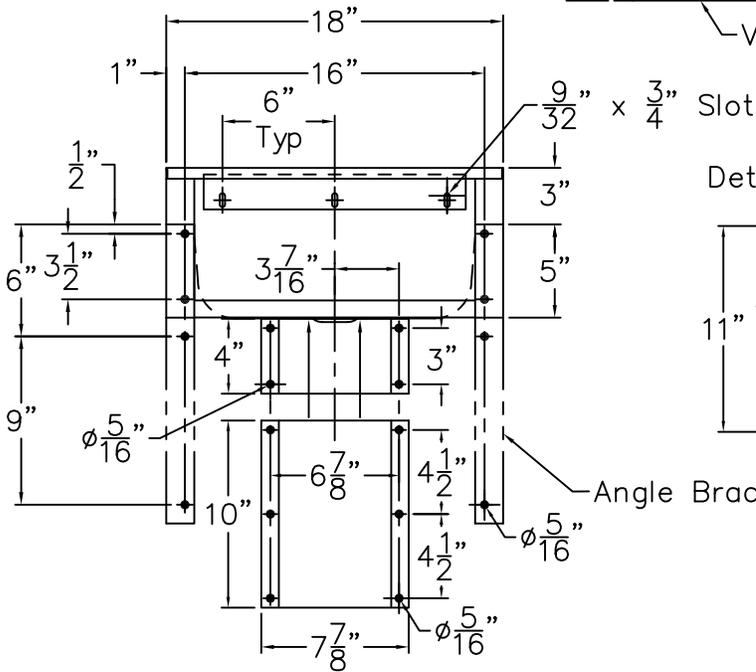

OPTION	DIM "A"	DIM "B"	DIM "C"	DIM "D"
-EE	17-1/2"	15-1/2"	7-3/4"	4"
-TE	23-1/2"	21-1/2"	10-3/4"	10"

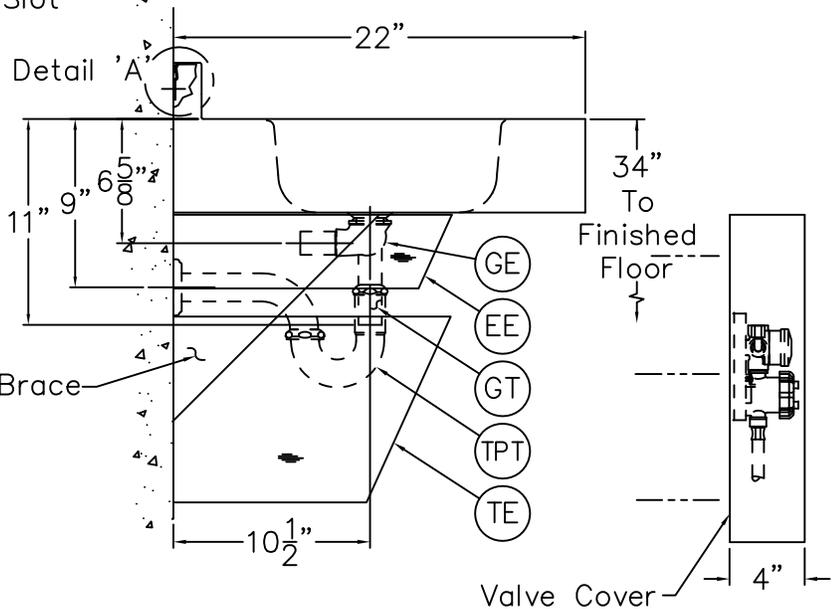

**INSTALLATION INSTRUCTIONS**

- A- SEE TABLE FOR CURRENT VALVE INSTALLATION SHEET.
- B- INSTALL MOUNTING BRACKET. SEE DETAIL "A".
- C- INSTALL WALL ANCHORS AND ATTACH FIXTURE. WALL ANCHORS AND ANCHORING HARDWARE BY OTHERS.
- D- MAKE WASTE CONNECTIONS. DIMENSIONS VARY DEPENDING ON OPTIONAL WASTE CONNECTION SELECTED:
  - GE GRID STRAINER WITH CLOSE ELBOW- 1-1/4" OD COMPRESSION CONNECTION
  - GT GRID STRAINER WITH TAILPIECE- 1-1/4" OD COMPRESSION CONNECTION
  - TPT TUBING P-TRAP 1-1/4" x 1-1/2" OD

**NOTE: REFER TO A.D.A. ACCESSIBILITY GUIDELINES FOR COMPLETE INSTALLATION REQUIREMENTS**

- E- OPTIONAL ENCLOSURES:
  - EE ELBOW ENCLOSURE FOR USE WITH -GE GRID STRAINER W/ CLOSE ELBOW
  - TE TRAP ENCLOSURE FOR USE WITH -TPT P-TRAP OR -GT GRID STRAINER W/ TAILPIECE
- F- ROUGH-IN PLUMBING AND FLUSH SUPPLY LINES.
- G- MOUNT OPTIONAL TRAP/ELBOW ENCLOSURE AND VALVE COVER AFTER INSTALLING PLUMBING. HARDWARE BY OTHERS.




ACORN ENGINEERING COMPANY  
P.O. BOX 3527 Industry, CA 91744  
15125 Proctor Ave Industry, CA 91746  
(626) 336-4561 FAX (626) 961-2200


TITLE		
<b>ADA COMPLIANT WALL HUNG LAVATORY - CAT. #1953-ADA</b>		
MANUFACTURE DATE	DATE ISSUED	DRAWING NUMBER
<b>JANUARY 1980 TO PRESENT</b>	<b>09-29-92</b>	<b>9908-006-001</b>
	DATE REVISED	
	<b>05/27/15</b>	






REFERENCE DRAWINGS	
ASSEMBLIES	NUMBERS
VALVE BODY	9955-005-003
STOP	9956-040-003
FIXTURE TRIM	9957-055-001
AIR-CONTROL SERVOMOTORS	
METERING	9955-000-003
NON-METERING	9955-001-003



TIMING IS ADJUSTABLE FROM 5 TO 60 SECONDS AND IS ACCOMPLISHED BY ROTATING TIMING SCREW. TURNING THE SCREW CLOCKWISE INCREASES WHILE COUNTERCLOCKWISE DECREASES TIMING.

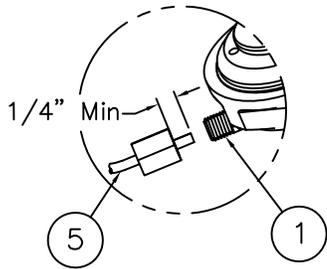

**DETAIL "A"**

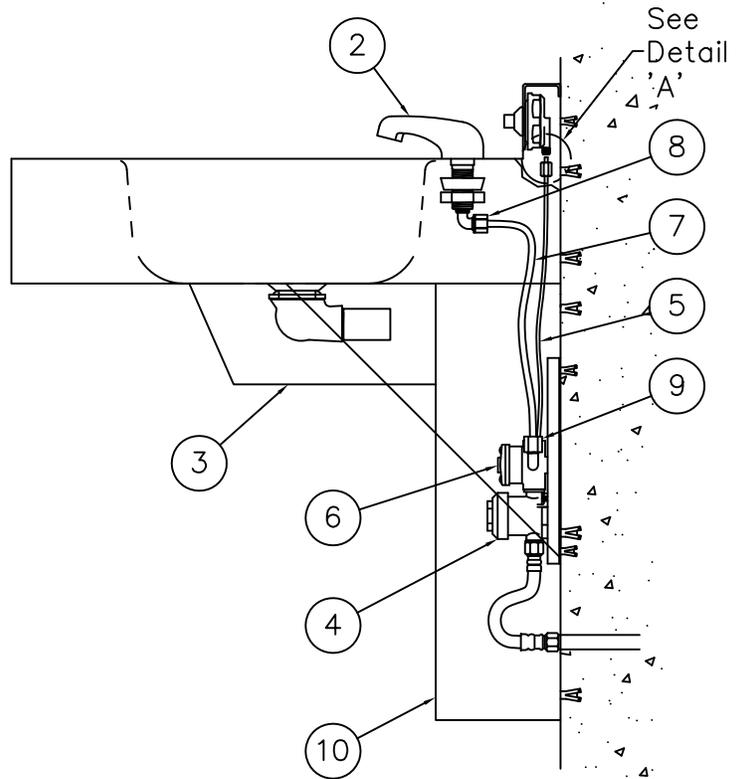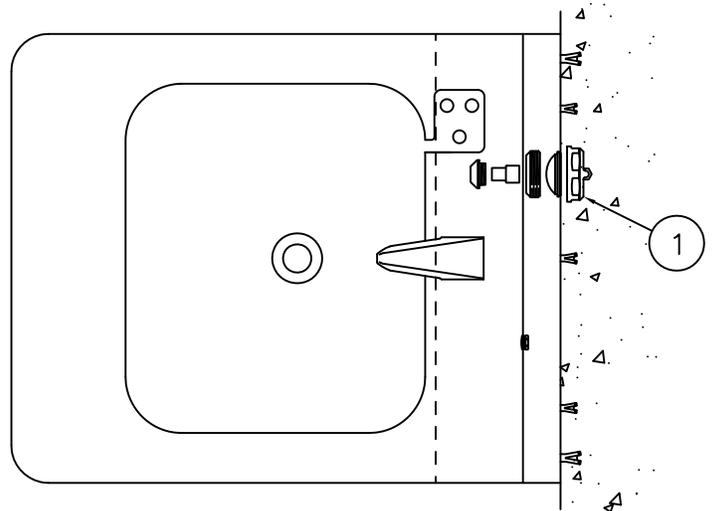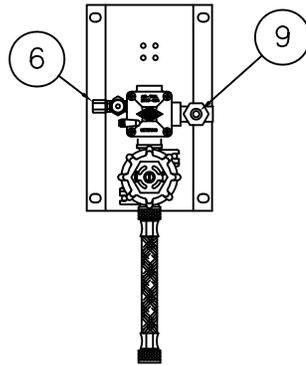

**INSTALLATION INSTRUCTIONS:**

- A- PRIOR TO INSTALLATION OF THE FIXTURE, MOUNT PUSHBUTTON (1) TO BACK SPLASH AND SPOUT (2) TO DECK.
- B- INSTALL THE FIXTURE TO THE WALL PER DRAWING #9908-006-001.
- C- INSTALL OPTIONAL TRAP/ELBOW ENCLOSURE (3) TO WALL. MOUNT AIR-CONTROL VALVE ASSEMBLY (4) TO WALL BELOW ENCLOSURE. MOUNTING HARDWARE BY OTHERS.
- D- CONNECT 1/8" O.D. POLYETHYLENE AIR LINES (5) TO PUSHBUTTON ASSEMBLIES (1) AND SERVOMOTORS (6). HAND TIGHTEN. USE FERRULE NUTS PROVIDED. SEE DETAIL 'A'.
- E- CONNECT 1/4" OD POLYETHYLENE WATER LINE (7) TO SPOUT COMPRESSION NUT (8) AND SERVOMOTOR COMPRESSION FITTING (9) USING FERRULE NUTS PROVIDED.
- F- AFTER THOROUGHLY FLUSHING THE SUPPLY LINES, MAKE-UP SUPPLY CONNECTIONS (1/2" NPT).
- G- SEE APPROPRIATE SERVOMOTOR REFERENCE DRAWING FOR DETAILS AND TIMING INSTRUCTIONS.
- H- INSTALL VALVE COVER (10) (SUPPLIED) TO WALL WITH NOTCH AROUND OPTIONAL TRAP/ELBOW ENCLOSURE (3). WALL FASTENERS BY OTHERS.


**NOTE:** WATER FLOW PRESSURE 25/100 PSI MIN/MAX. RECOMMENDED OUTLET TEMPERATURE 105° MAX. FLUSH ALL SUPPLY LINES THOROUGHLY BEFORE CONNECTING. DRAIN VALVE PRIOR TO FREEZING TEMPERATURES.



ACORN ENGINEERING COMPANY  
P.O. BOX 3527 Industry, CA 91744  
15125 Proctor Ave Industry, CA 91746  
(626) 336-4561 FAX (626) 961-2200

TITLE **FRONT MOUNTED SINGLE TEMP AIR-CONTROL VALVE CAT. #1953-ADA-03**

MANUFACTURE DATE	DATE ISSUED	DRAWING NUMBER
<b>APRIL 1994</b>	<b>05/18/94</b>	
<b>TO PRESENT</b>	DATE REVISED	<b>9908-106-002</b>
	<b>05/27/15</b>	

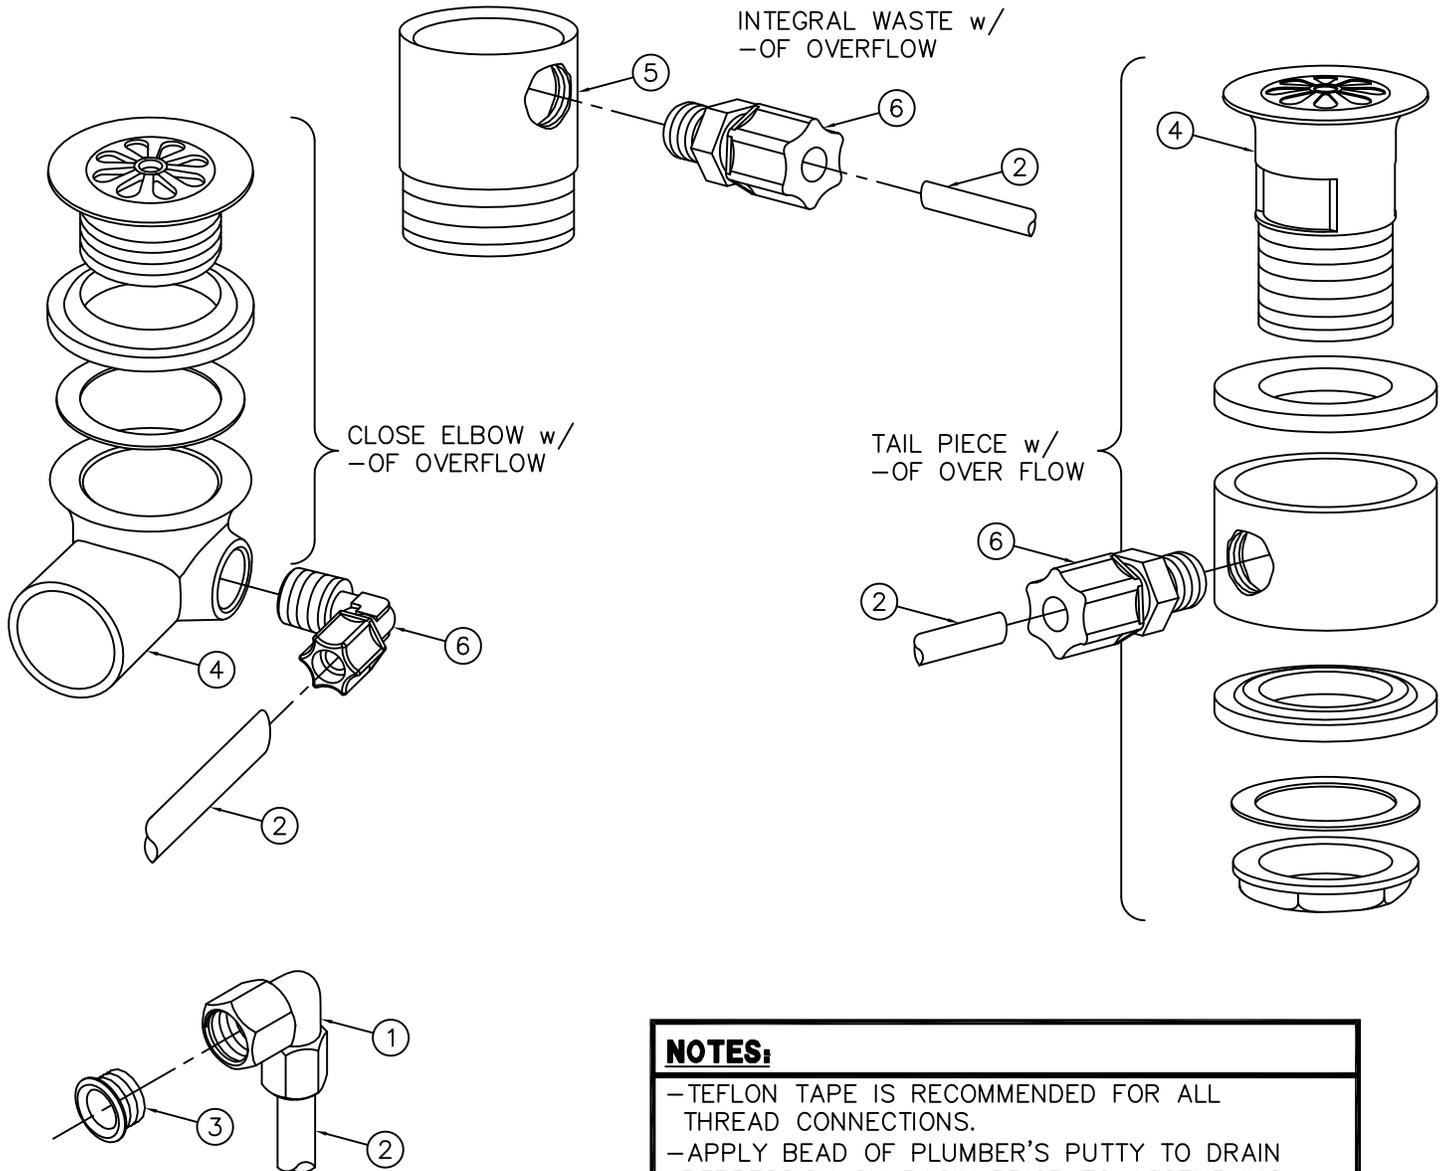

**INSTALLATION INSTRUCTIONS:**

A- ASSEMBLE 3/8" NPT x 3/8" OD ELBOW (1) TO 3/8" PE TUBE PROVIDED (2). THREAD OVERFLOW INSERT (3) THROUGH OVERFLOW OPENING(S) IN BASIN AND HAND TIGHTEN THE INSERT (3) TO THE ELBOW ASSEMBLY.

B- ASSEMBLE APPLICABLE WASTE CONNECTION (4) TO DRAIN OPENING AS SHOWN. NOTE: INTEGRAL DRAIN (5) REQUIRES NO ASSEMBLY.

C- FIT 3/8" OD PE TUBING (2) FROM OVERFLOW CONNECTION (1) TO OVERFLOW CONNECTION ON WASTE ASSEMBLY. NOTE: INSTALLER MAY CUT PE TUBING TO LENGTH. TIGHTEN 3/8" NPT x 3/8" OD TUBE CONNECTION PROVIDED (6) TO 3/8" OD PE TUBE (2). TIGHTEN TO (4) OR (5) WASTE ASSEMBLY AS SHOWN.



ACORN ENGINEERING COMPANY  
P.O. BOX 3527 Industry, CA 91744  
15125 Proctor Ave Industry, CA 91746  
(626) 336-4561 FAX (626) 961-2200

TITLE <b>OPTIONAL -OF OVERFLOW WASTE ASSEMBLY</b>		
MANUFACTURE DATE <b>JULY 2008</b> <b>TO PRESENT</b>	DATE ISSUED <b>07/21/08</b>	DRAWING NUMBER <b>9927-008-001</b>
	DATE REVISED <b>01/06/14</b>	