





1 CONTROLLER MAY ONLY BE ORDERED AS A COMPLETE UNIT WITH PROGRAMMING, OR WITHOUT PROGRAMMING. TAMPERING WITH INTERNAL COMPONENTS WILL VOID WARRANTY.

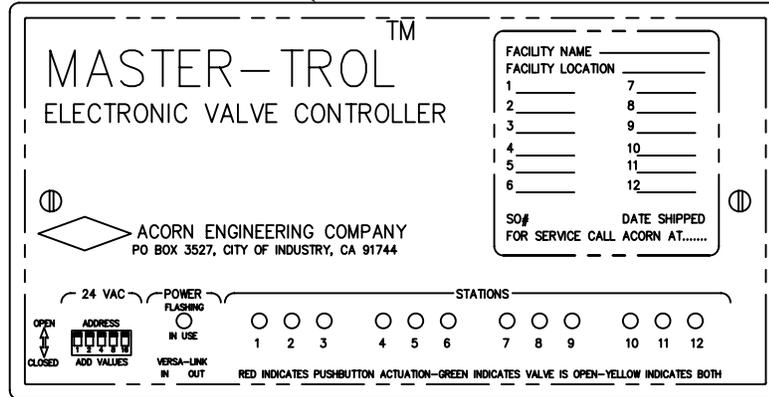

120 V/60 Hz
PRIMARY POWER
(BY OTHERS)

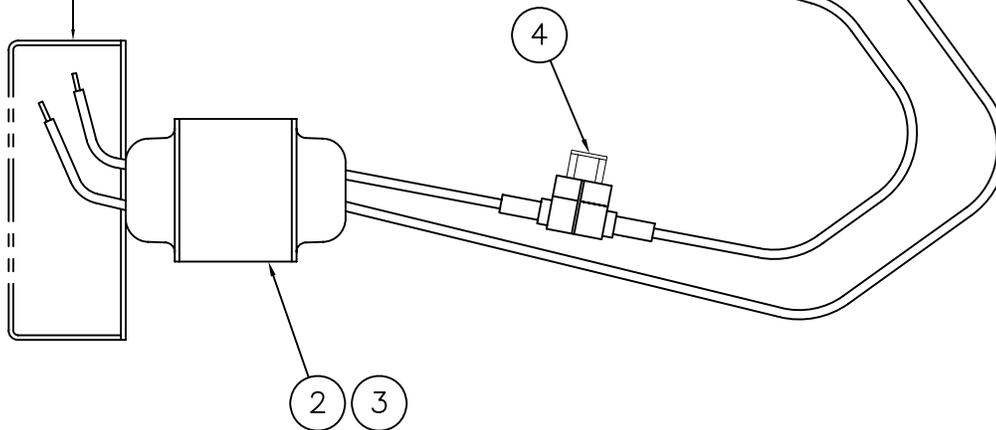

120V/24V/50VA, UL/CSA APPROVED TRANSFORMER IS FURNISHED COMPLETE W/2' LEADS, FUSE, AND FUSEHOLDER.
ITEM #2, TRANSFORMER W/4" x 4" MTG PLATE SHOWN 4" x 4" BOX SUPPLIED BY OTHERS.

1A	0715-002-001	LESS PROGRAMMED CONTROLLER	3	0710-710-001	50 VA TRANSFORMER w/CLAMP MOUNT
1B	0715-003-001	PROGRAMMED CONTROLLER	4	0713-060-000	3 AMP REPLACEMENT FUSE
2	0710-700-001	50 VA TRANSFORMER w/4" x 4" MTG PLATE			
ITEM	PART NUMBER	DESCRIPTION	ITEM	PART NUMBER	DESCRIPTION
ACORN ENGINEERING COMPANY P.O. BOX 3527 INDUSTRY, CA. 91744 (626) 336-4561 FAX (626) 961-2200					
TITLE VALVE CONTROLLER & TRANSFORMER ASSEMBLY					
MANUFACTURE DATE 10/28/92 TO PRESENT			DATE ISSUED 01/01/93		DRAWING NUMBER 9957-110-001
			DATE REVISED 03/07/11		